






Pipe Types


ABS	Acrylonitrile-Butadiene-Styrene
AC	Asbestos Concrete
CC	Concrete Cylinder
CI	Cast Iron
CIPP	Cured In Place Pipe
CMP	Corrugated Metal
CN	Concrete
CU	Copper
DI	Ductile Iron
FC	Formed Concrete
GI	Galvanized Iron
HDPE	High Density Polyethylene
MLC	Mortar Lined Concrete
PE	Polyethylene
PVC	Polyvinylchloride
RC	Reinforced Concrete
ST	Steel
TC	Techite
UNK	Unknown
VC	Vitrified Clay
WS	Wood Stave
WST	Welded Steel
NP	No Print
*	Private System

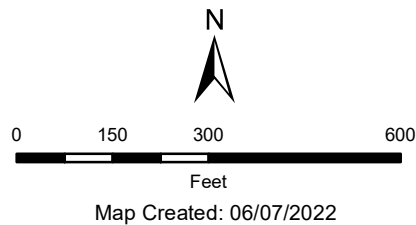

Legal:
SW 1/4 Sec11 T12N R4W

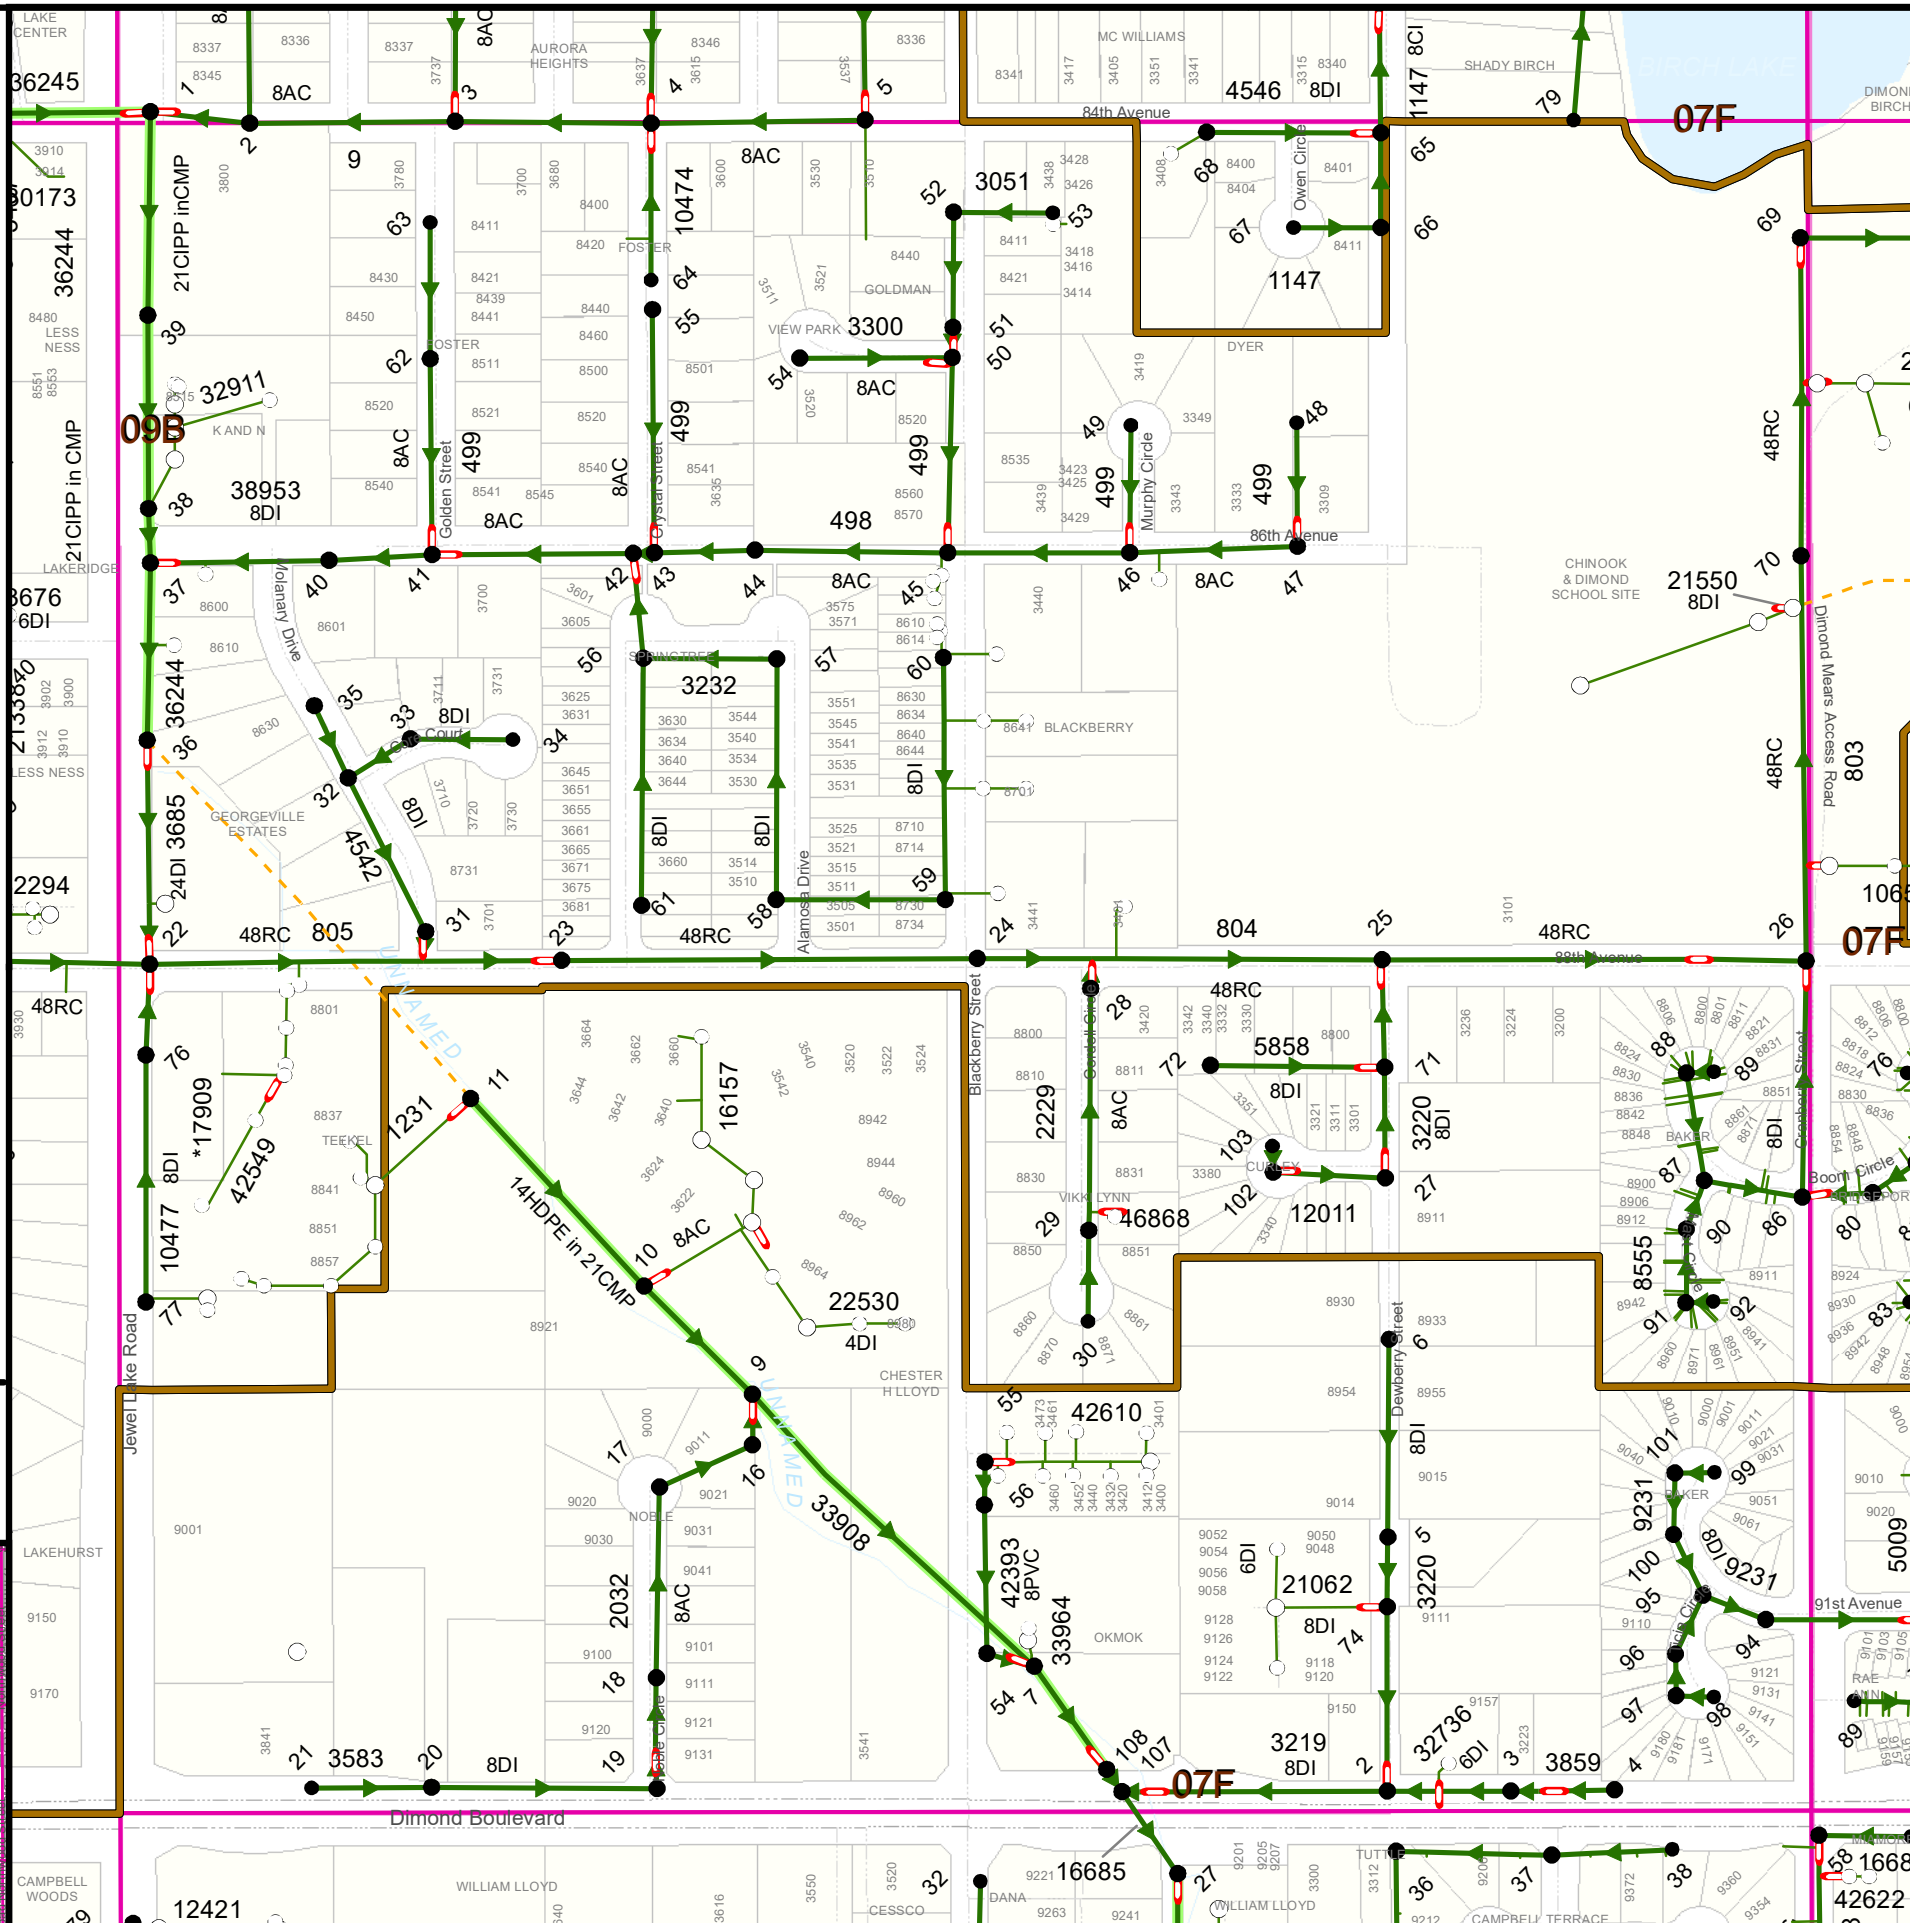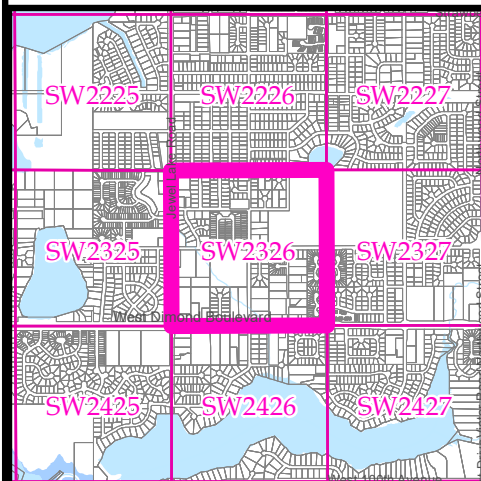


Anchorage Bowl

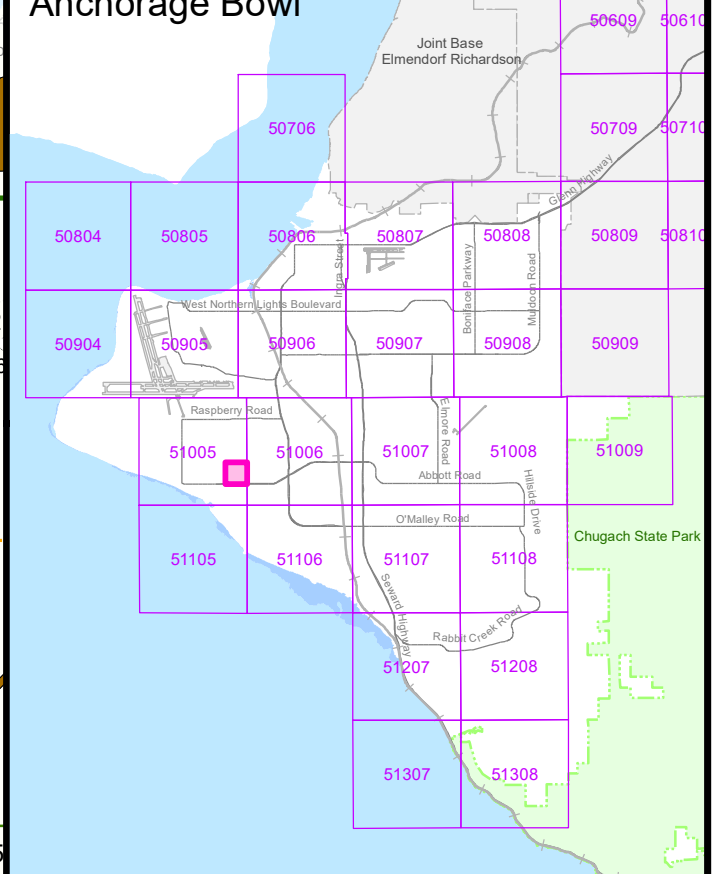


Legend

Constructed and Design

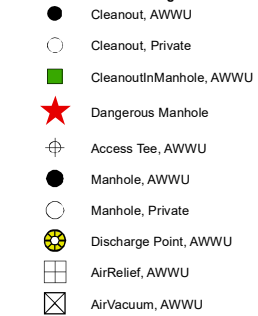

	Administration Facility
	Lift/Pump Station
	Metering Station
	Septage Receiving Station
	Treatment Facility

Constructed Pipe

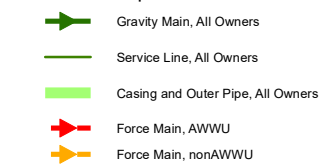

Design Pipe



 Force Main, AWWU
 Force Main, nonAWWU

Retired Pipe

— — — Abandoned in Place, All Owners

 Record Drawing Limit



INFORMATION AND DATA CONTAINED ON THIS DOCUMENT IS NOT TO BE CONSIDERED ACCURATE AND THE MUNICIPALITY OF ANCHORAGE ASSUMES NO LIABILITY FOR DAMAGES OCCURRING AS A RESULT OF USING THIS DOCUMENT. FOR THE LATEST AND MOST UP TO DATE INFORMATION YOU ARE URGED TO CALL THE ANCHORAGE WATER & WASTEWATER UTILITY AT (907) 564-2725 BEFORE STARTING OPERATIONS.

Wastewater Collection System

Grid Number SW2326