

SMOKE COMP

- 01 01
- 02 02
- 02 2

OCCUPANT LOAD

- Accessory Storage Area - Equipment Room
- Assembly - without fixed seats - only - (not food)
- Institutional areas - Inpatient
- Institutional areas - Outpatient
- Business
- Institutional areas - Sleep
- Institutional areas - Commercial
- Kitchens, Commercial

FUNCTION OF SPACE


- Accessory Storage Area
- Mechanical Equipment Room
- Assembly - without fixed seats - (chairs only - not food)
- Institutional areas - Inpatient
- Treatment Areas
- Institutional areas - Outpatient
- Institutional areas - Commercial
- Institutional areas - Sleep
- Atrium
- Kitchens, Commercial

LEGEND

- FEB - FIRE EXTINGUISHER
- S-SD - FIRE ALARM PULL
- FA PULL - FIRE ALARM PULL
- EMERG. LT. - EMERGENCY LIGHT
- EXIT - EXIT
- EXIT SIGN - EXIT SIGN
- TRAVEL DISTANCE TO AN EXIT
- TRAVEL DISTANCE TO A SMOKE COMPARTMENT
- COMMON PATH OF TRAVEL

NOTES

- BSA CONDUCTED A VISUAL OBSERVATION AND HAS DOCUMENTED THAT THE BUILDING IS IN COMPLIANCE WITH THE ORIGINAL BUILDING AND SAFETY CODES AND ALL APPLICABLE REGULATORY REQUIREMENTS.
- ALL AREAS ARE 12 OCCUPANCY CLASSIFICATION.
- FLOOR FINISHING WORK IS IN PROGRESS IN THE FOLLOWING AREAS:
- WALL FINISHING IS NOT COMPLETE IN THE FOLLOWING AREAS:
- SOME CORRIDOR CEILING CONSTRUCTION TYPE UNUSUAL.
- FULLY SMOKE-RESISTANT

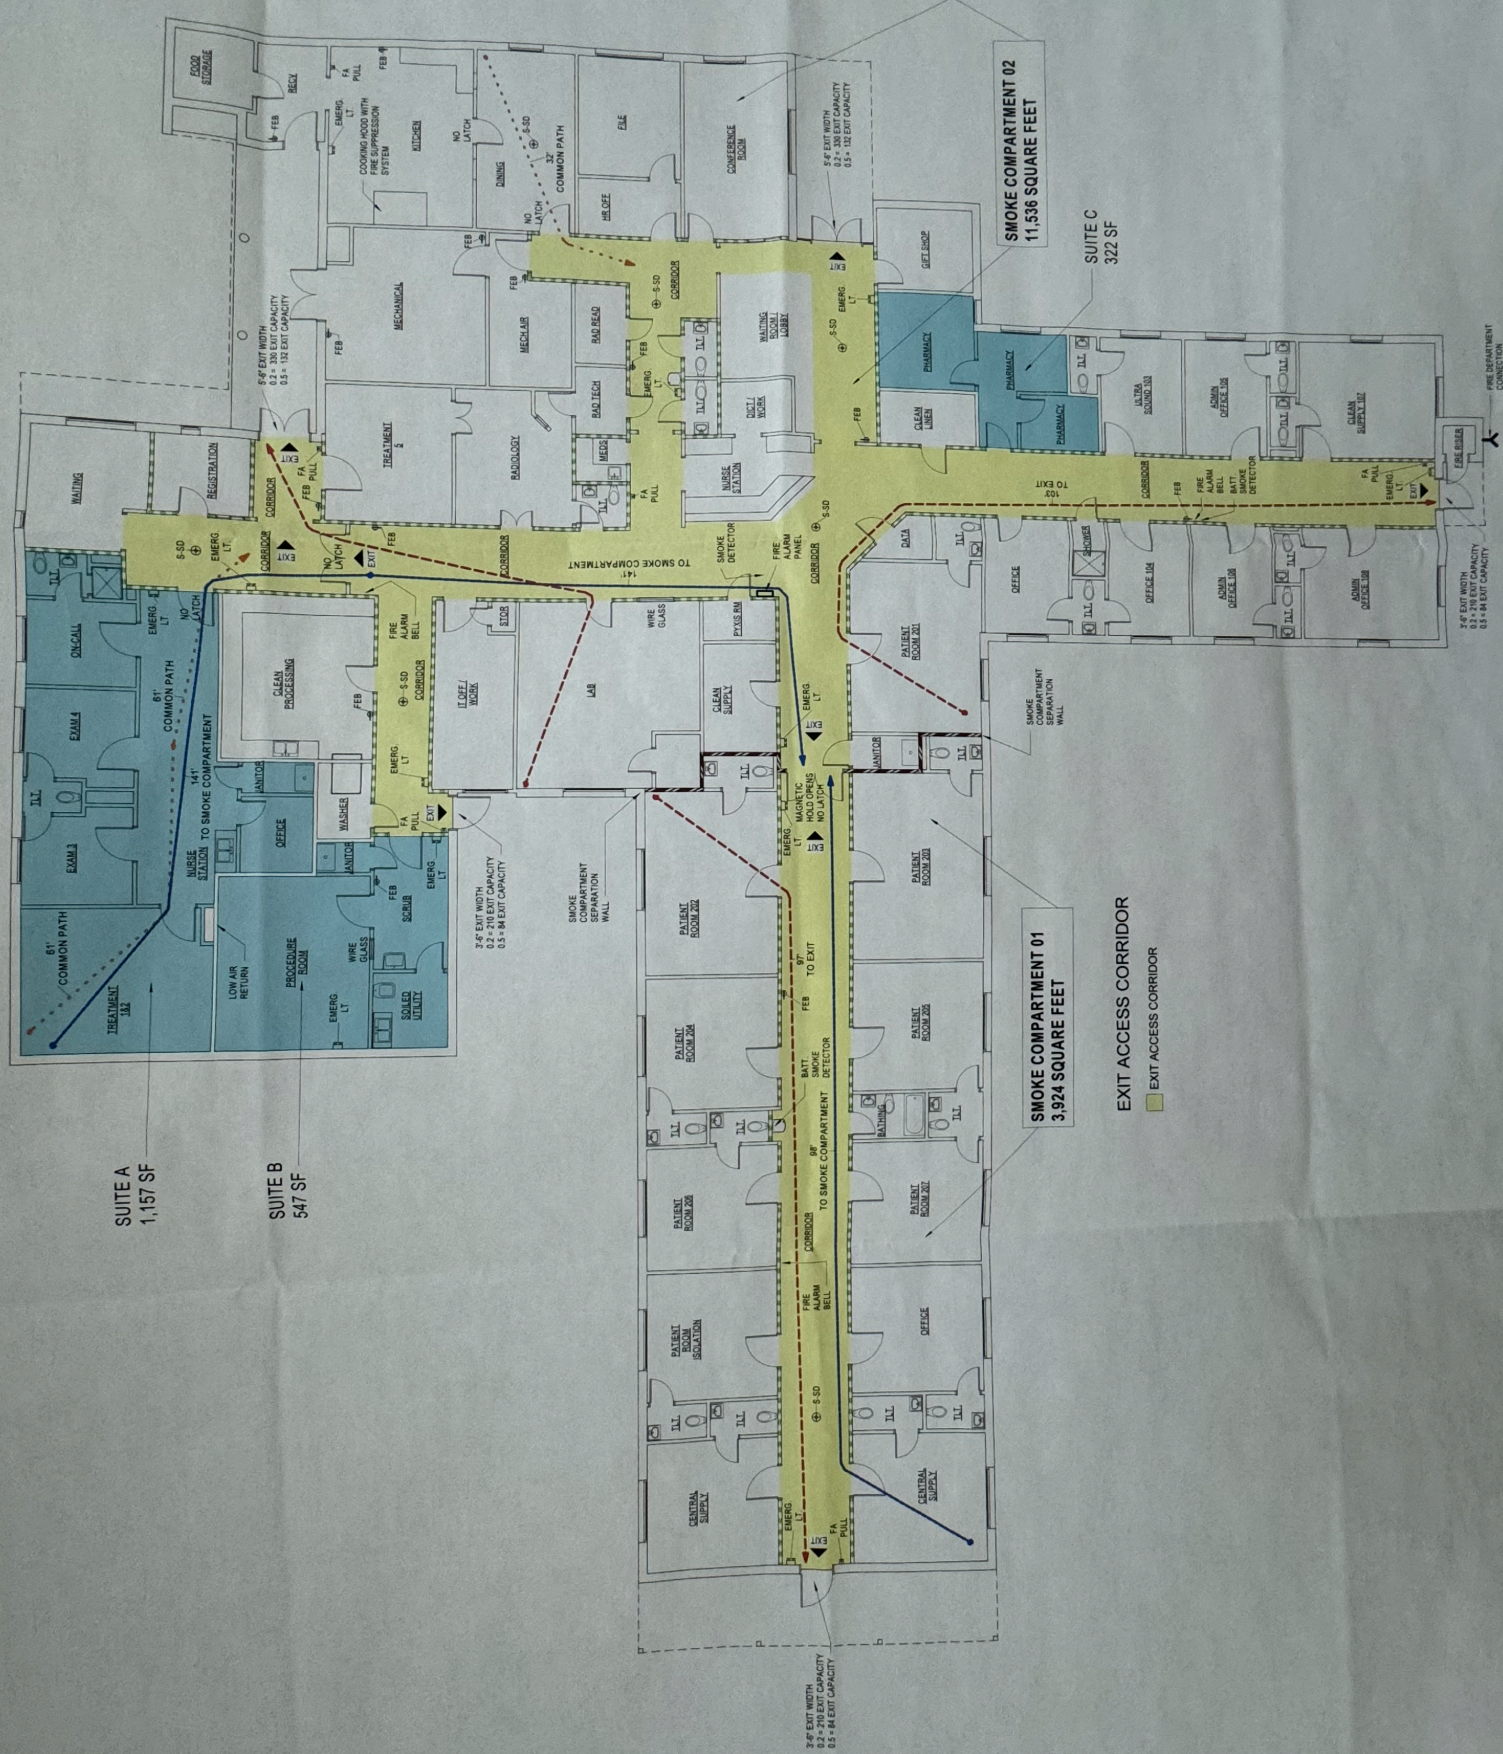

SUITE A
1,157 SF

SUITE B
547 SF

SMOKE COMPARTMENT 02
11,536 SQUARE FEET

SMOKE COMPARTMENT 01
3,924 SQUARE FEET

EXIT ACCESS CORRIDOR

EXIT ACCESS CORRIDOR

SUITE C
322 SF

3'-6" EXIT WIDTH
0.2 - 210 EXIT CAPACITY
0.5 - 94 EXIT CAPACITY

3'-6" EXIT WIDTH
0.5 - 133 EXIT CAPACITY
0.5 - 133 EXIT CAPACITY

3'-6" EXIT WIDTH
0.2 - 210 EXIT CAPACITY
0.5 - 94 EXIT CAPACITY

3'-6" EXIT WIDTH
0.2 - 126 EXIT CAPACITY
0.5 - 116 EXIT CAPACITY

3'-6" EXIT WIDTH
0.5 - 141 EXIT CAPACITY
0.5 - 141 EXIT CAPACITY

3'-6" EXIT WIDTH
0.5 - 141 EXIT CAPACITY
0.5 - 141 EXIT CAPACITY

3'-6" EXIT WIDTH
0.5 - 141 EXIT CAPACITY
0.5 - 141 EXIT CAPACITY