


Caution: Before starting any excavation call 811, One-Call (888 253 0808) or Texas Excavation Safety System (800 344 8377) at least forty eight hours in advance to locate any buried utility lines.



SCALE: 1" = 40'

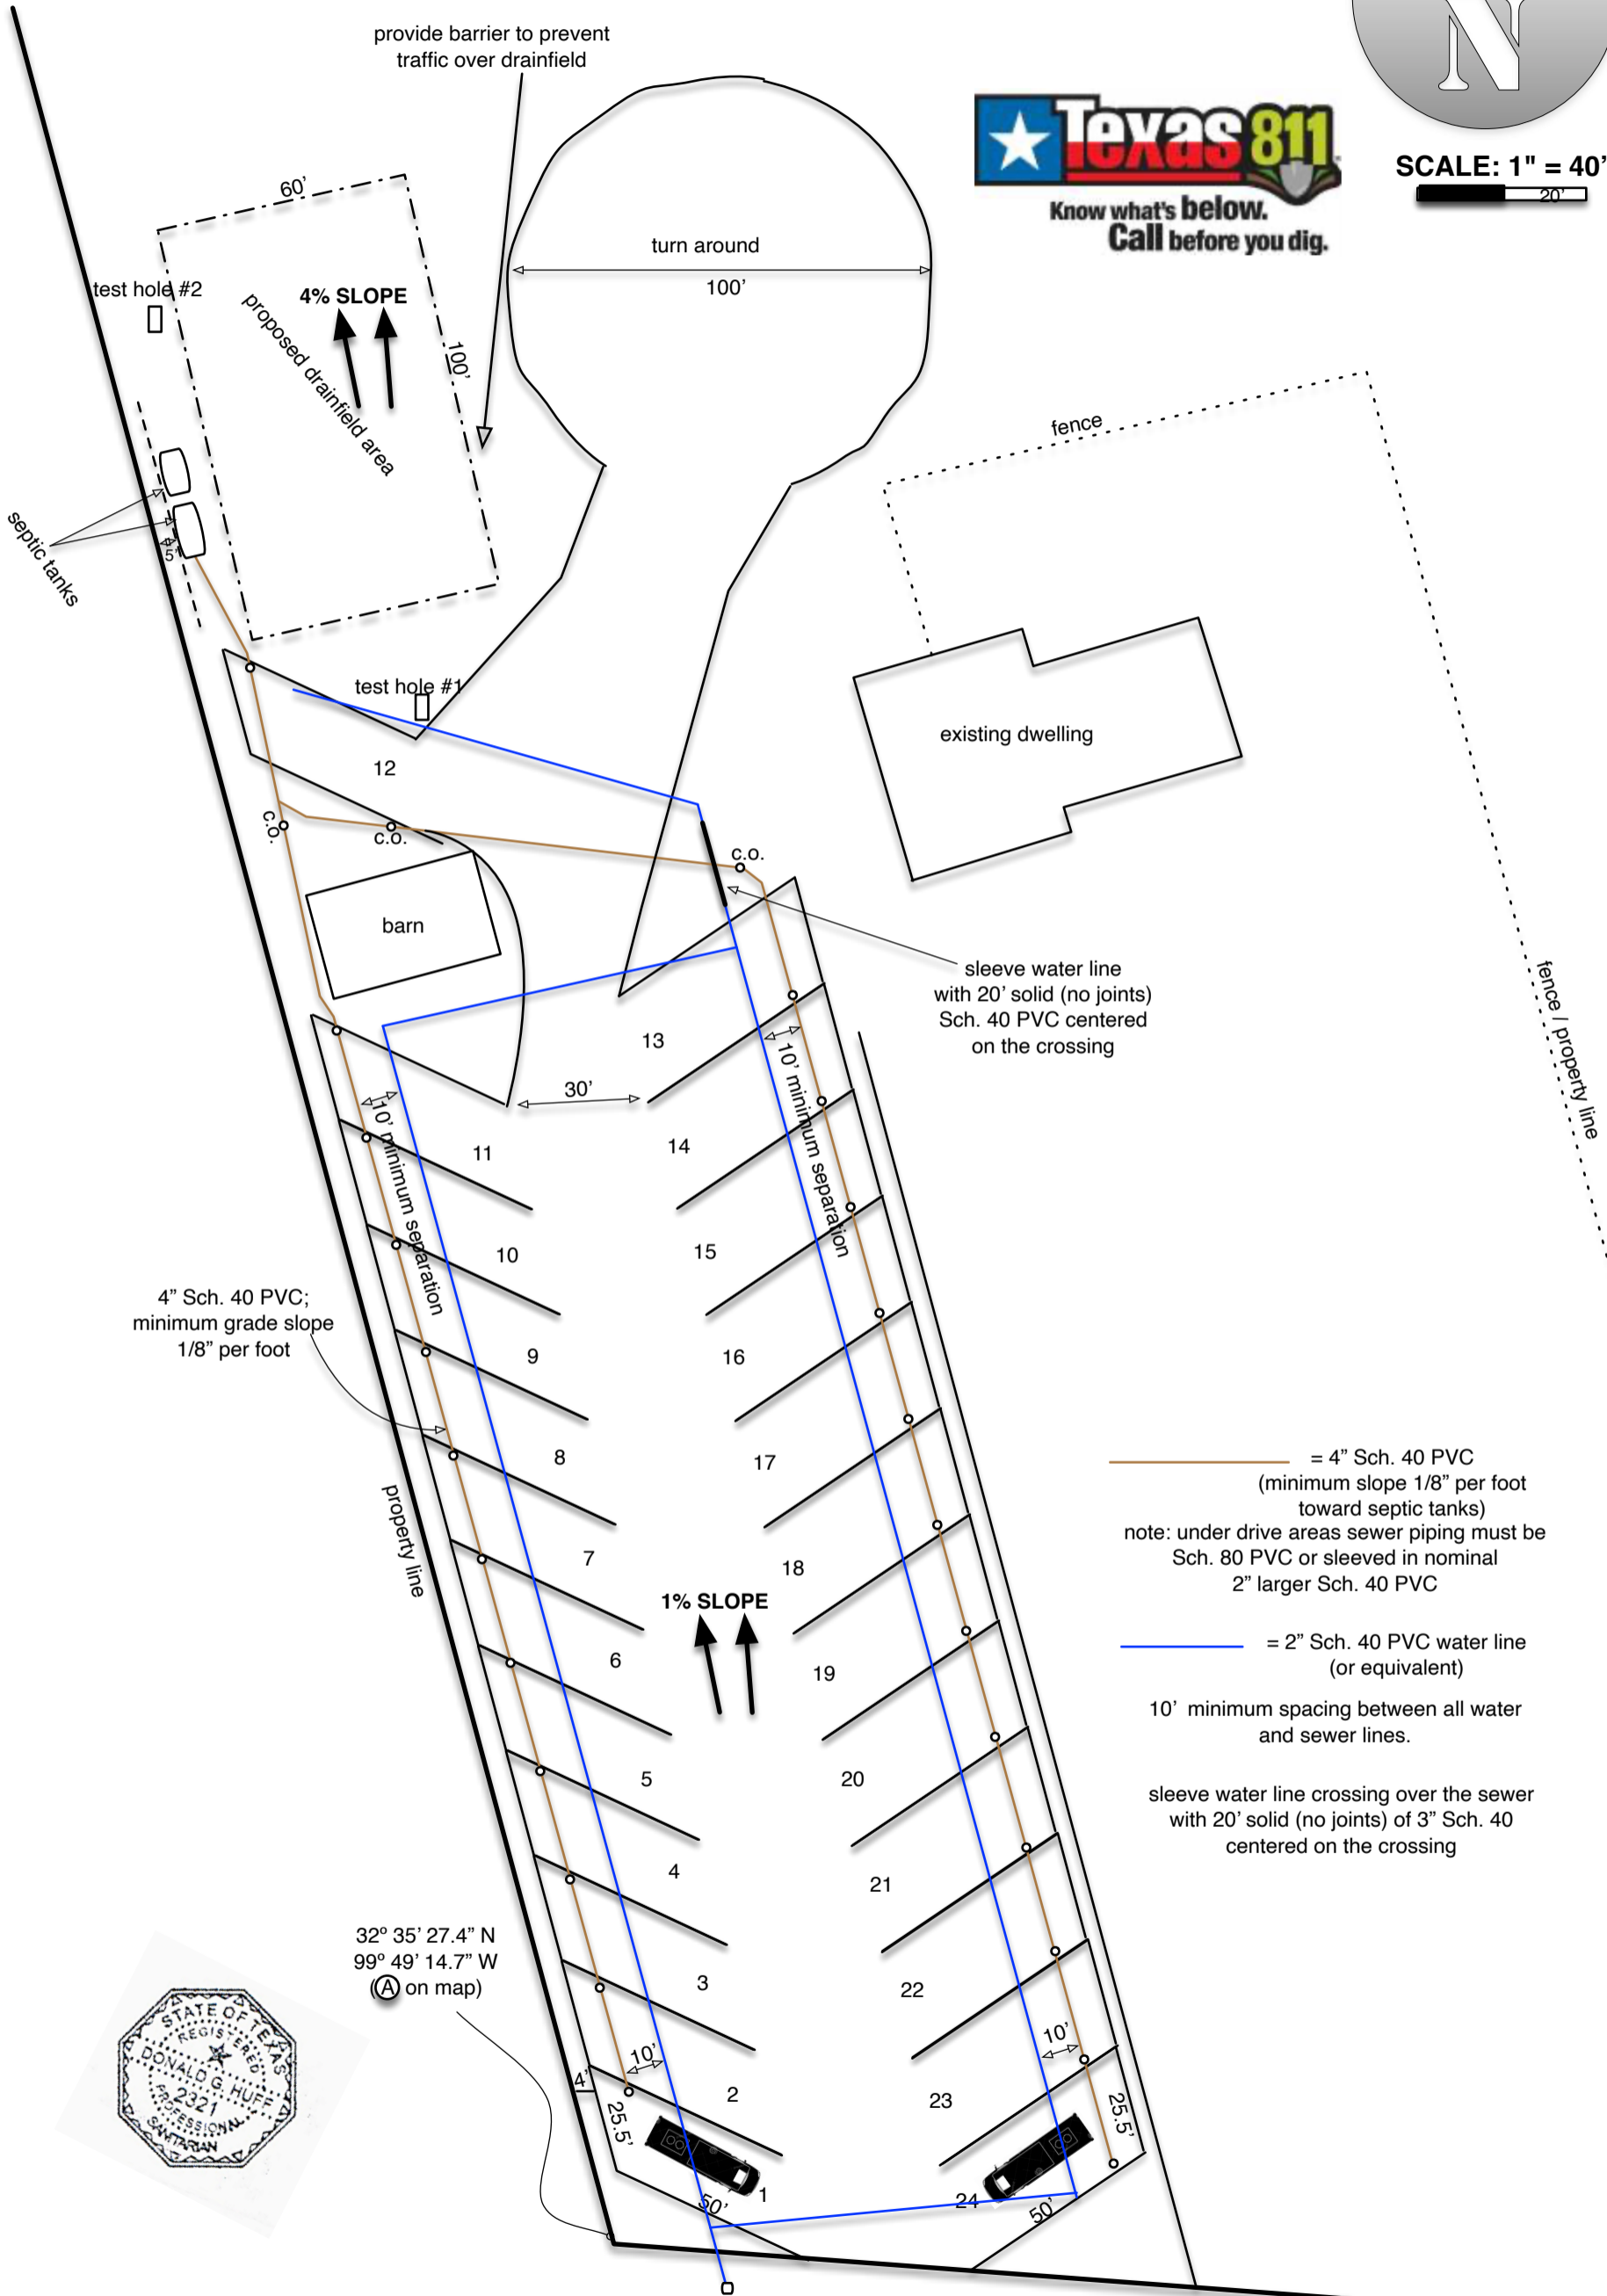

- = 4" Sch. 40 PVC (minimum slope 1/8" per foot toward septic tanks)
 note: under drive areas sewer piping must be Sch. 80 PVC or sleeved in nominal 2" larger Sch. 40 PVC
- = 2" Sch. 40 PVC water line (or equivalent)
- 10' minimum spacing between all water and sewer lines.
- sleeve water line crossing over the sewer with 20' solid (no joints) of 3" Sch. 40 centered on the crossing

32° 35' 27.4" N
 99° 49' 14.7" W
 (A) on map



Newman RV Park Property
 1450 FM 605
 Hawley, Jones Co., TX

SITE LAYOUT

FM 605

Septic Systems by Design
 Don Huff, R. S. (OS0010810)

1725 Westwood Dr.
 Abilene, Texas 79603
 (325) 665-0216