

EXIT = EXIT SING *SEE FOLLOWING NOTES:*

THE EXIT PATH SHALL BE IDENTIFIED BY EXIT SIGNS CONFORMING TO THE REQUIREMENTS OF SECTION 1013. EXIT SIGNS SHALL BE READILY VISIBLE FROM ANY DIRECTION OF APPROACH. EXIT SIGNS SHALL BE LOCATED AS NECESSARY TO CLEARLY INDICATE THE DIRECTION OF EGRESS TRAVEL. NO POINT SHALL BE MORE THAN 100 FEET FROM THE NEAREST VISIBLE SIGN.(1013.1)


E.L. = EMERGENCY LIGHTING

THE EMERGENCY POWER SYSTEM SHALL PROVIDE POWER FOR A DURATION OF NOT LESS THAN 90 MINUTES AND SHALL CONSIST OF STORAGE BATTERIES, UNIT EQUIPMENT OR AN ON-SITE GENERATOR. THE INSTALLATION OF THE EMERGENCY POWER SYSTEM SHALL BE IN ACCORDANCE WITH SECTION 2702.


EMERGENCY LIGHTING FACILITIES SHALL BE ARRANGED TO PROVIDE INITIAL ILLUMINATION THAT IS AT LEAST AN AVERAGE OF 1 FOOT-CANDLE (11 LUX) AND A MINIMUM AT ANY POINT OF 0.1 FOOT-CANDLE (1 LUX) MEASURED ALONG THE PATH OF EGRESS AT FLOOR LEVEL. ILLUMINATION LEVELS SHALL BE PERMITTED TO DECLINE TO 0.6 FOOT-CANDLE (6 LUX) AVERAGE AND A MINIMUM AT ANY POINT OF 0.06 FOOT-CANDLE (0.6 LUX) AT THE END OF THE EMERGENCY LIGHTING TIME DURATION. A MAXIMUM-TO-MINIMUM ILLUMINATION UNIFORMITY RATIO OF 40 TO 1 SHALL NOT BE EXCEEDED.

NOTE:

MEAN OF EGRESS ILLUMINATION. THE POWER SUPPLY FOR MEANS OF EGRESS ILLUMINATION SHALL NORMALLY BE PROVIDED BY THE PREMISES' ELECTRICAL SUPPLY. IN THE EVENT OF POWER SUPPLY FAILURE, AN EMERGENCY ELECTRICAL SYSTEM SHALL AUTOMATICALLY ILLUMINATE THE FOLLOWING AREAS: AISLES AND UNENCLOSED EGRESS STAIRWAYS IN ROOMS AND SPACES THAT REQUIRE TWO OR MORE MEANS OF EGRESS. CORRIDORS, EXIT ENCLOSURES AND EXIT PASSAGEWAYS IN BUILDINGS REQUIRED TO HAVE TWO OR MORE EXITS; EXTERIOR EGRESS COMPONENTS AT OTHER THAN THE LEVEL OF EXIT DISCHARGE UNTIL EXIT DISCHARGE IS ACCOMPLISHED FOR BUILDINGS REQUIRED TO HAVE TWO OR MORE EXITS; INTERIOR EXIT DISCHARGE ELEMENTS, AS PERMITTED IN SECTION 1028.1. IN BUILDINGS REQUIRED TO HAVE TWO OR MORE EXITS; EXTERIOR LANDINGS, AS REQUIRED BY SECTION 1010.1.6, FOR EXIT DISCHARGE DOORWAYS IN BUILDINGS REQUIRED TO HAVE TWO OR MORE EXITS. REFERENCE CBC SEES. 1 008.

WALL LEGEND	
	EXISTING CONCRETE WALL TO REMAIN
	EXISTING 2x STUD WALLS (NON-BEARING WALL)
	NEW 2x STUD WALLS (NON-BEARING WALL)

DOOR SCHEDULE				
STATUS	SYM	SIZE	TYPE	QTY
NEW		3'-0" x 6'-8"	COMMERCIAL WOOD DOOR	6
EXISTING		3'-0" x 6'-8"	COMMERCIAL WOOD DOOR	7
EXISTING		6'-0" x 6'-8"	STORE FRONT GLASS DOOR	1
EXISTING		3'-0" x 6'-8"	METAL DOOR	2

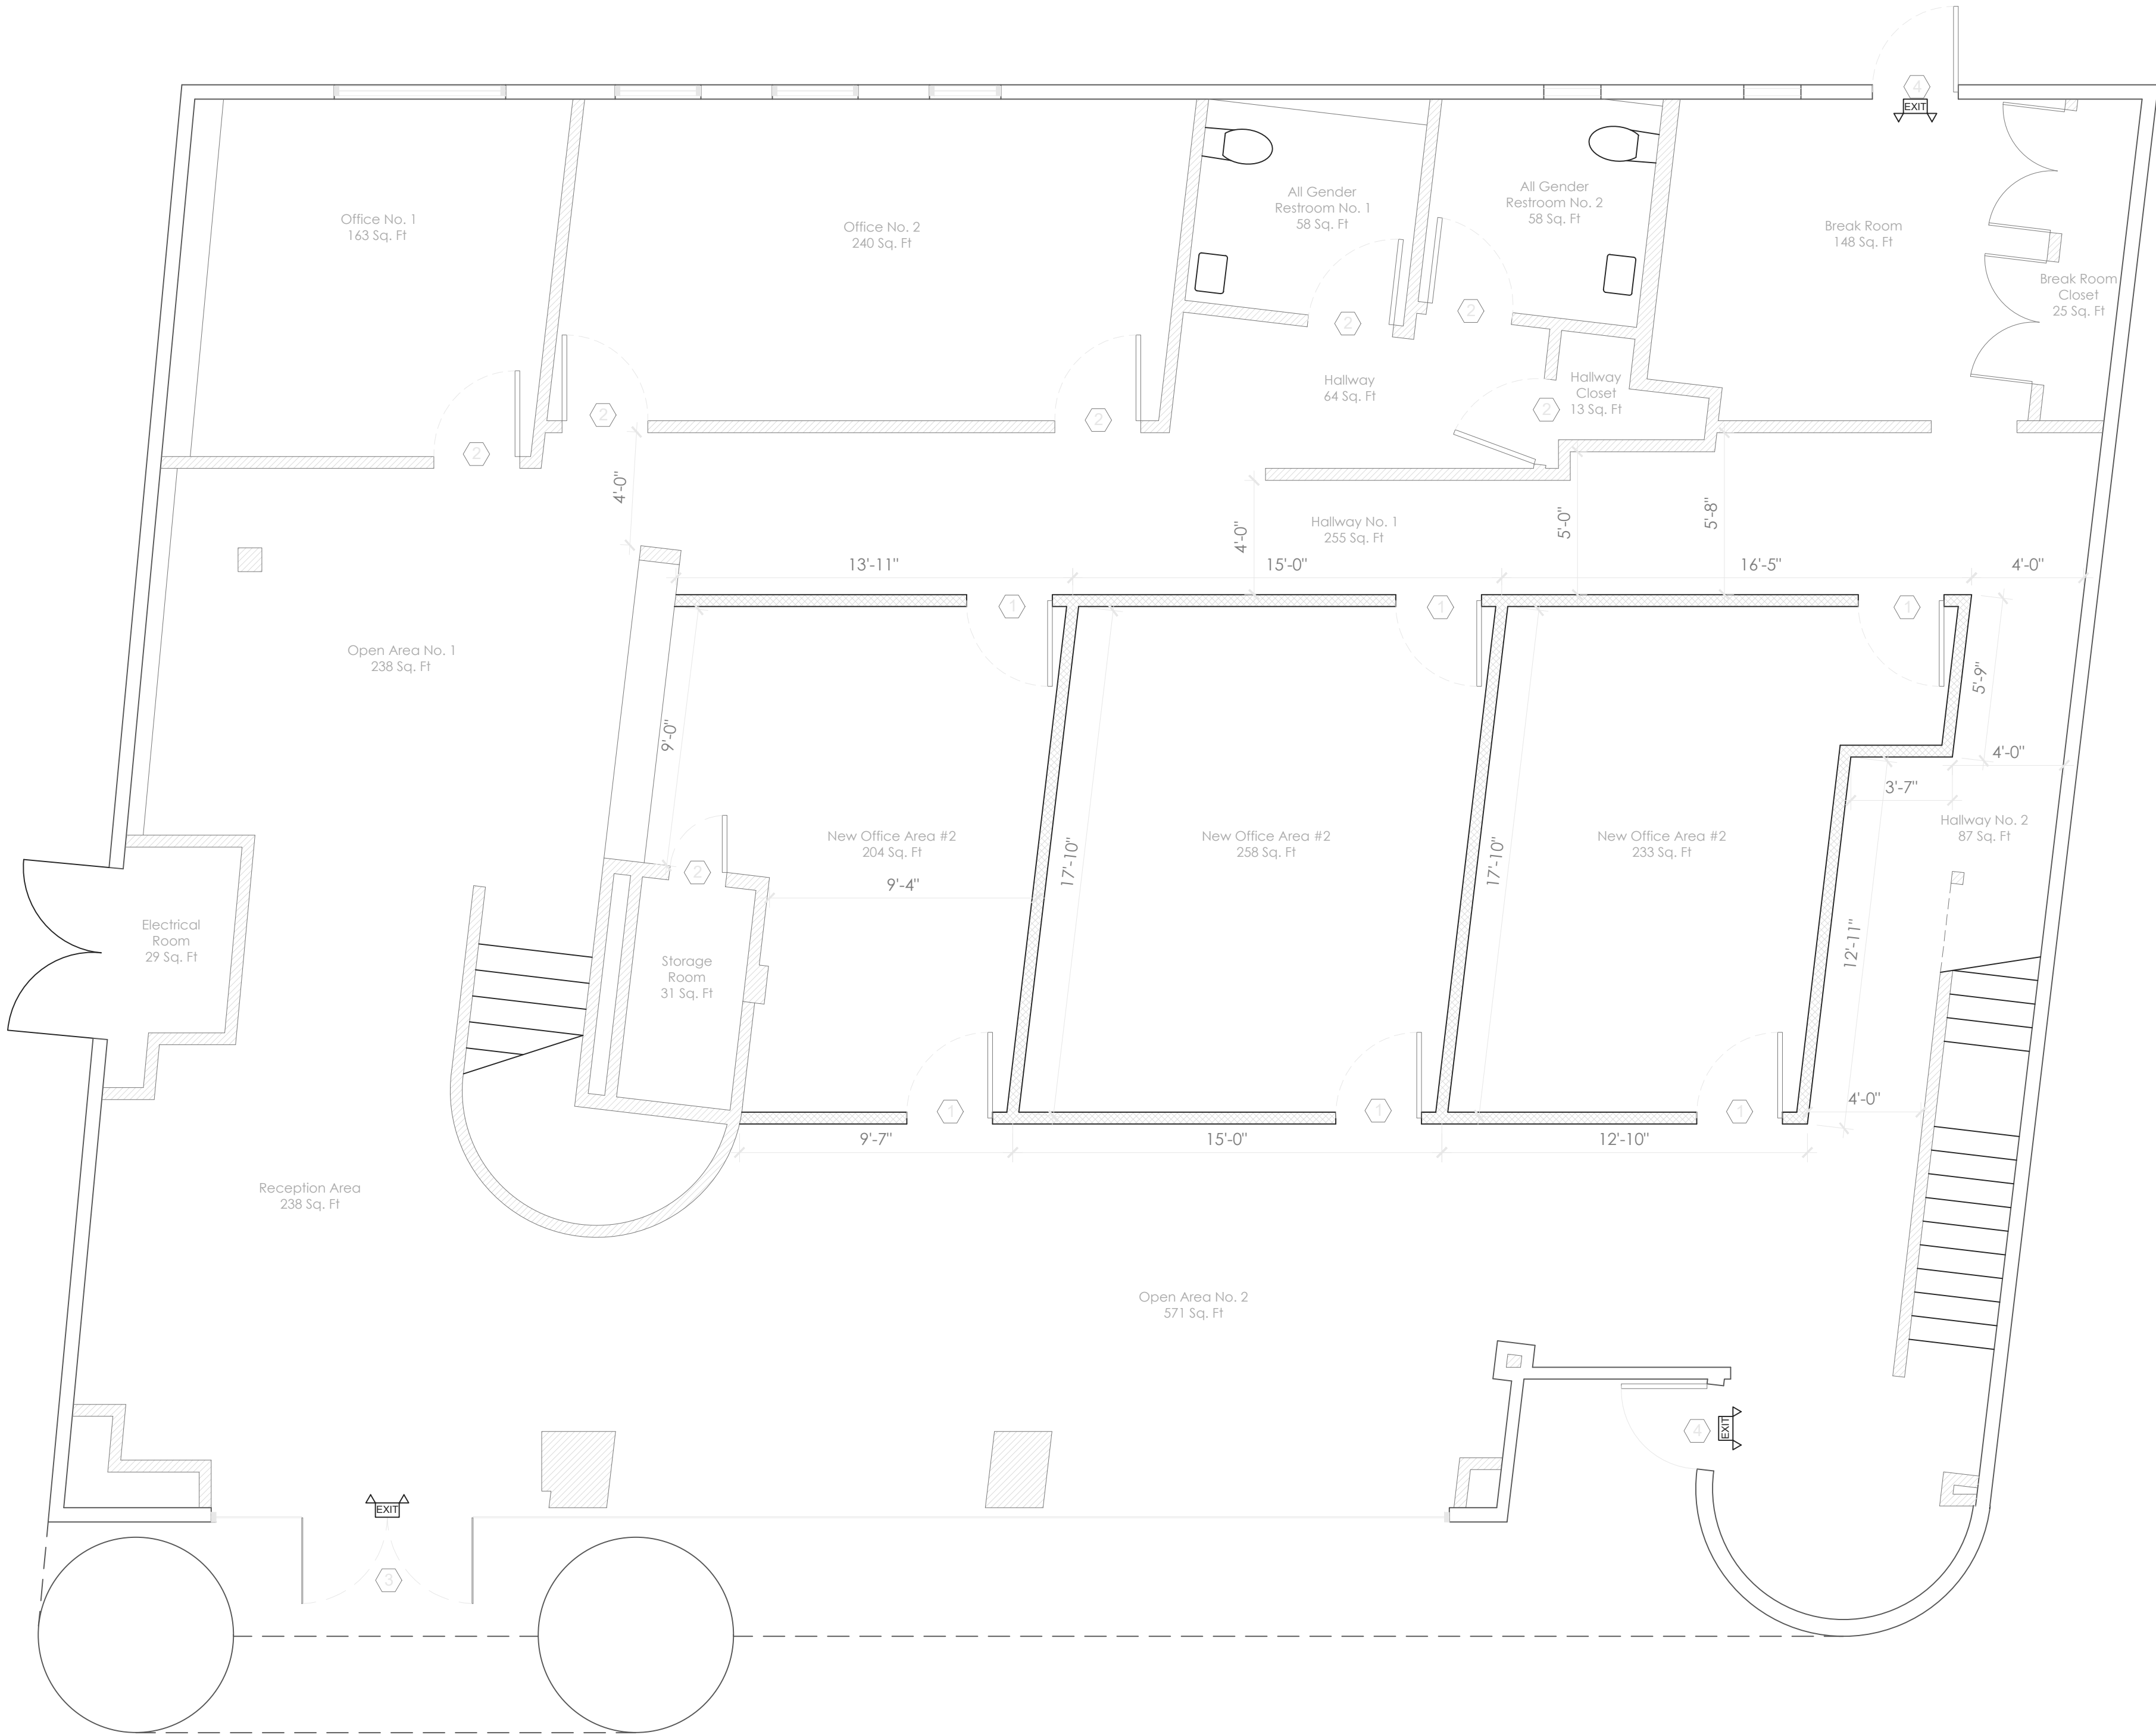

City Revisions:	
1	
2	
3	
4	
5	

Engineer Stamp:

Department:
Building Dept.

Drawing Drawn By:
A. Cardenas

Approved By:
T. Cardenas


Date of Drawing:
January 14, 2020

Sheet Name:
Existing Floor Plan 1st

Drawing Scale:
1/4" = 1'-0"

Sheet Count:
4 of 6

Page No.

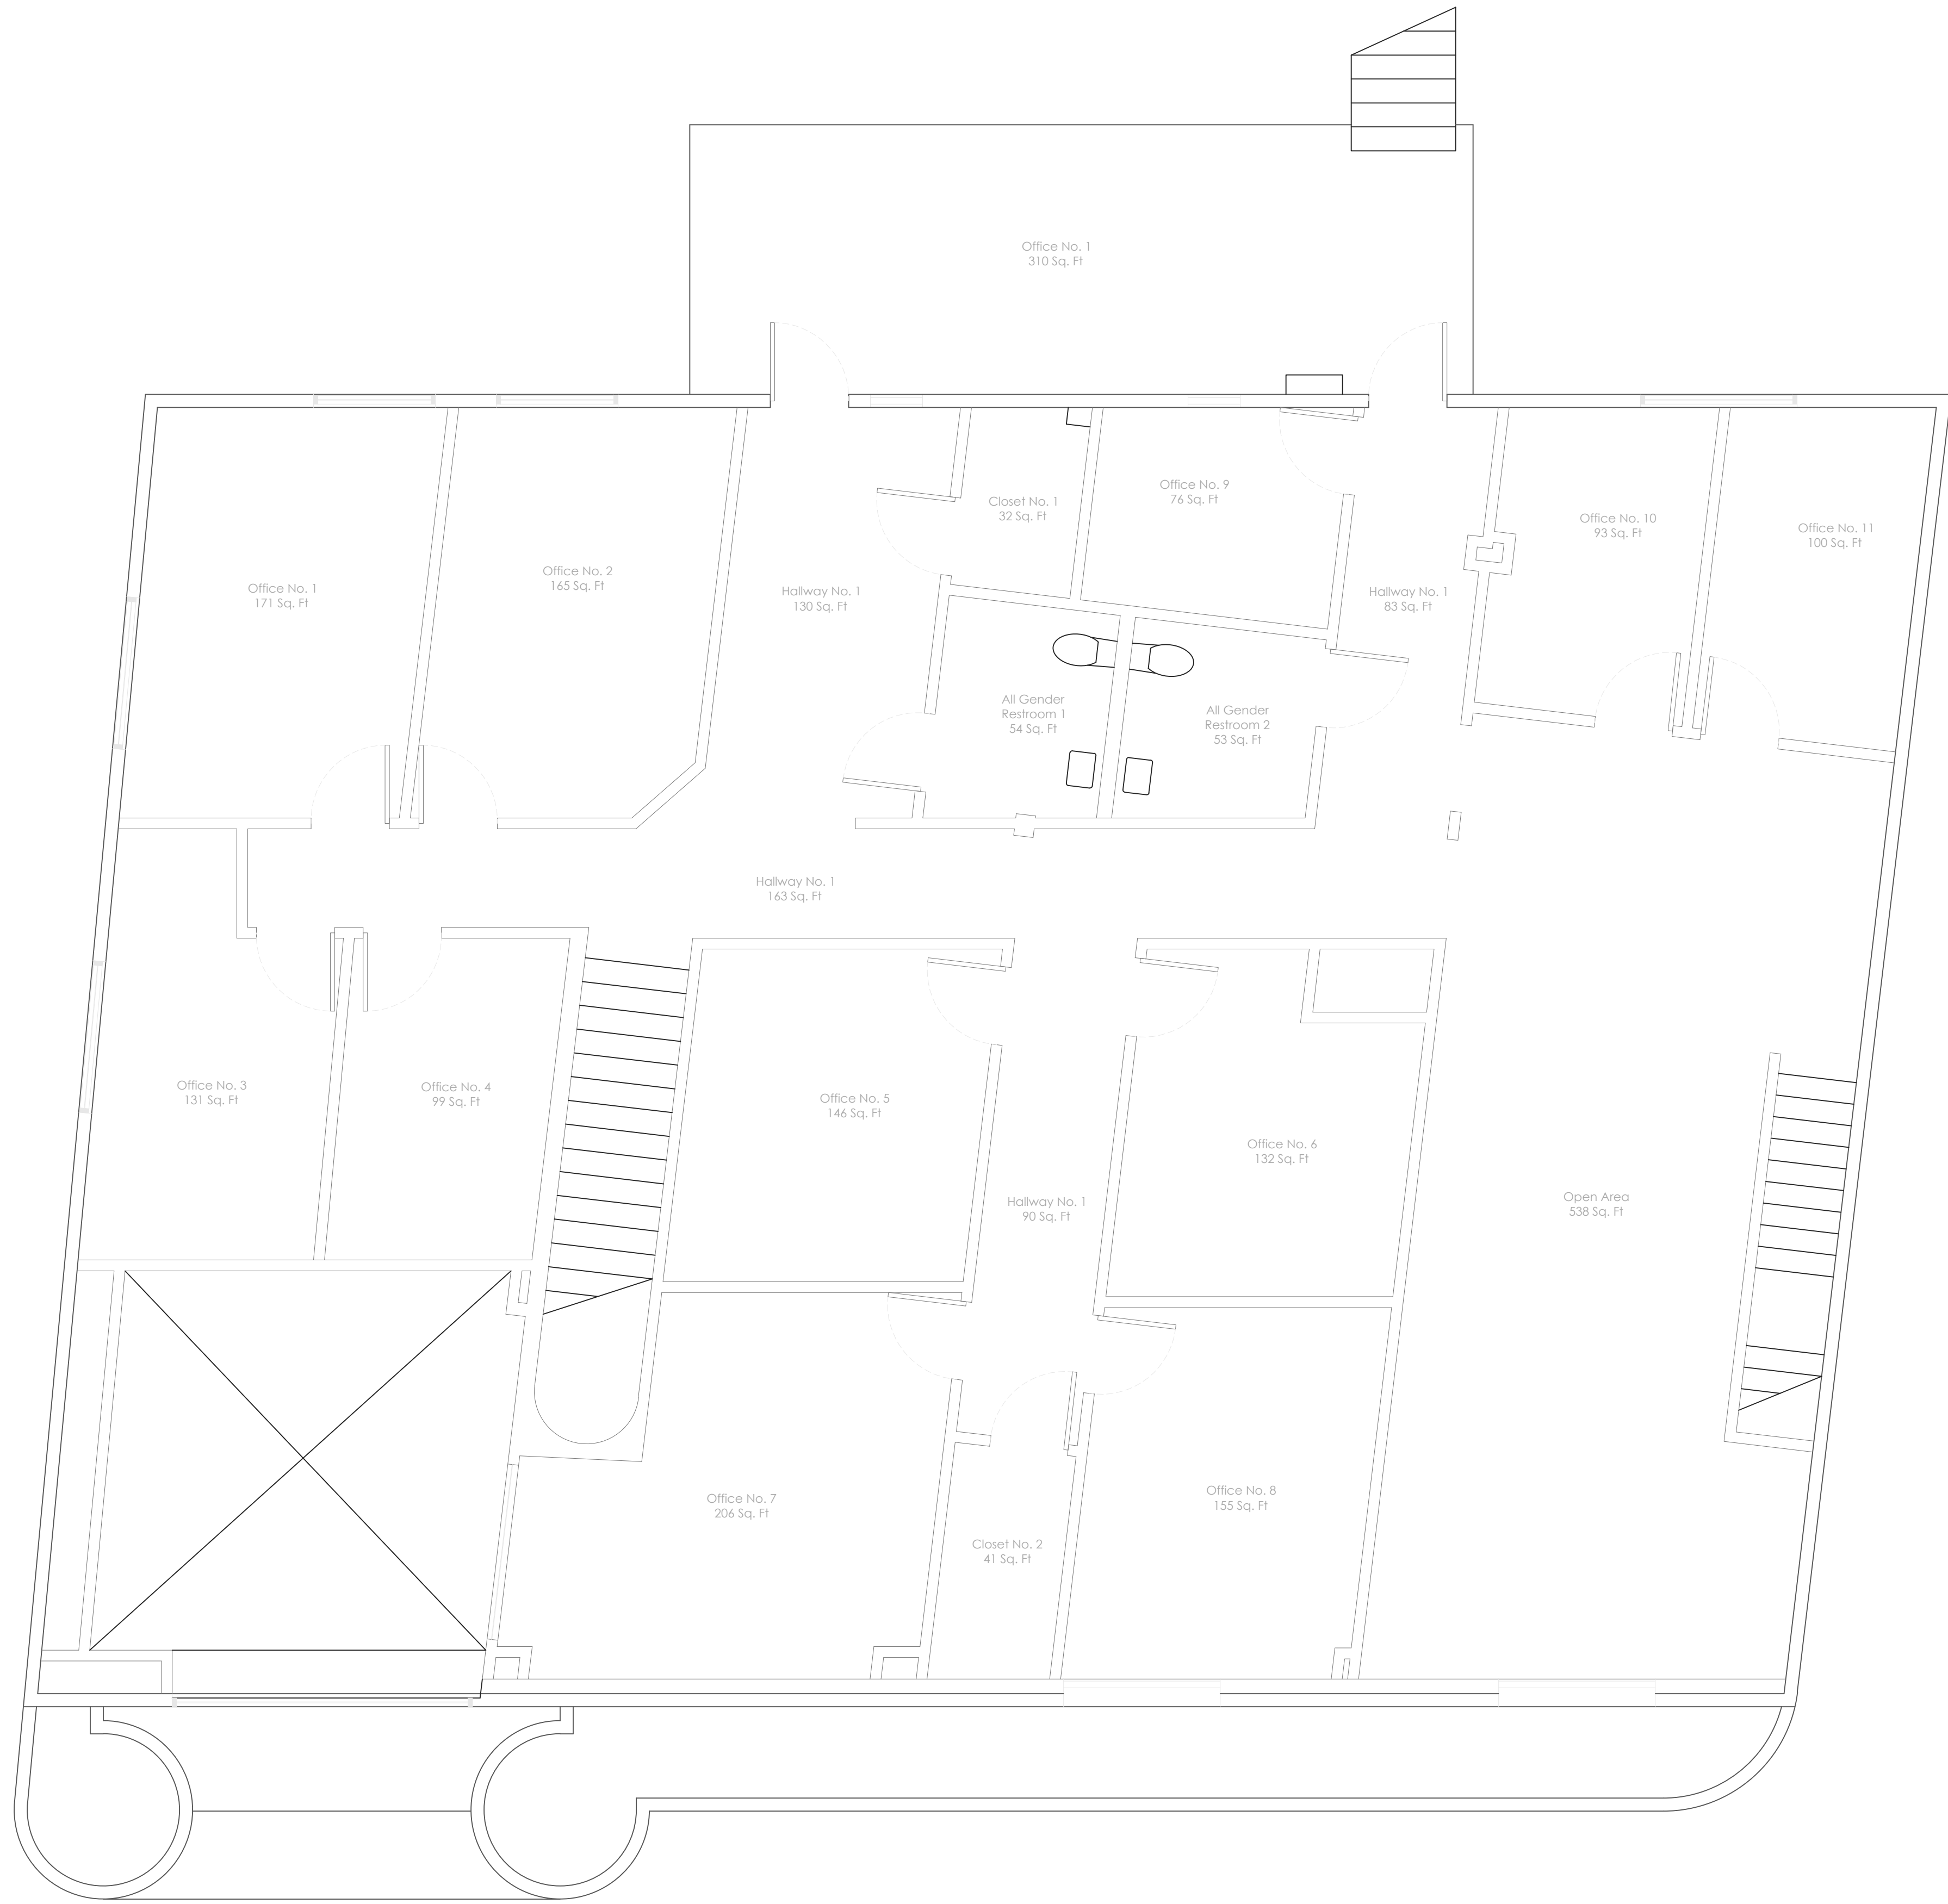

City Revisions:	
1	
2	
3	
4	
5	

Engineer Stamp:

Department:
Building Dept.

Drawing Drawn By:
A. Cardenas

Approved By:
T. Cardenas

Date of Drawing:
January 14, 2020

Sheet Name:
Existing Floor Plan 2nd

Drawing Scale:
1/4" = 1'-0"

Sheet Count:
3 of 6