


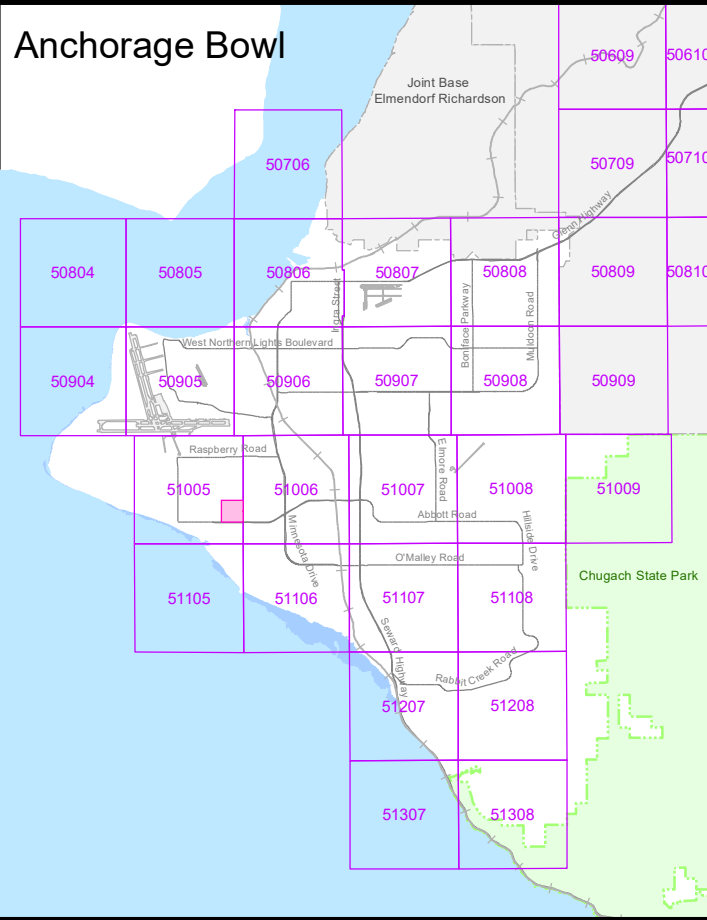

Legend

All Status (Constructed, Design, Standby)

- Gate or Butterfly, AWWU
- Gate or Butterfly, nonAWWU
- All Valve Types, All Owners, Closed
- Single, AWWU
- Single, Private
- Single, Unknown Owner
- Double, AWWU
- Double, Private
- Flushing, AWWU
- All Hydrant, Other Utility
- Well, AWWU
- Well, Private

Constructed Pipe

- Main, AWWU
- Service Line, Private
- Main, Other Utility
- Casing and Outer Pipe, All Owners

Design Pipe

- Main, AWWU
- Service Line, Private

Retired Pipe

- Abandoned in Place, All Owners


Other

- Record Drawing Limit
- Other Regulated Utility
- Pressure Zone
- MOA Grid

Facilities

- Administration Facility
- Air Vacuum Facility
- Booster Station Facility
- Pressure Reducing Facility
- Reservoir Facility
- Valve Facility
- Well Facility
- Water Treatment Facility

INFORMATION AND DATA CONTAINED ON THIS DOCUMENT IS NOT TO BE CONSIDERED ACCURATE AND THE MUNICIPALITY OF ANCHORAGE ASSUMES NO LIABILITY FOR DAMAGES OCCURRING AS A RESULT OF USING THIS DOCUMENT. FOR THE LATEST AND MOST UP TO DATE INFORMATION YOU ARE URGED TO CALL THE ANCHORAGE WATER & WASTEWATER UTILITY AT (907) 564-2725 BEFORE STARTING OPERATIONS.

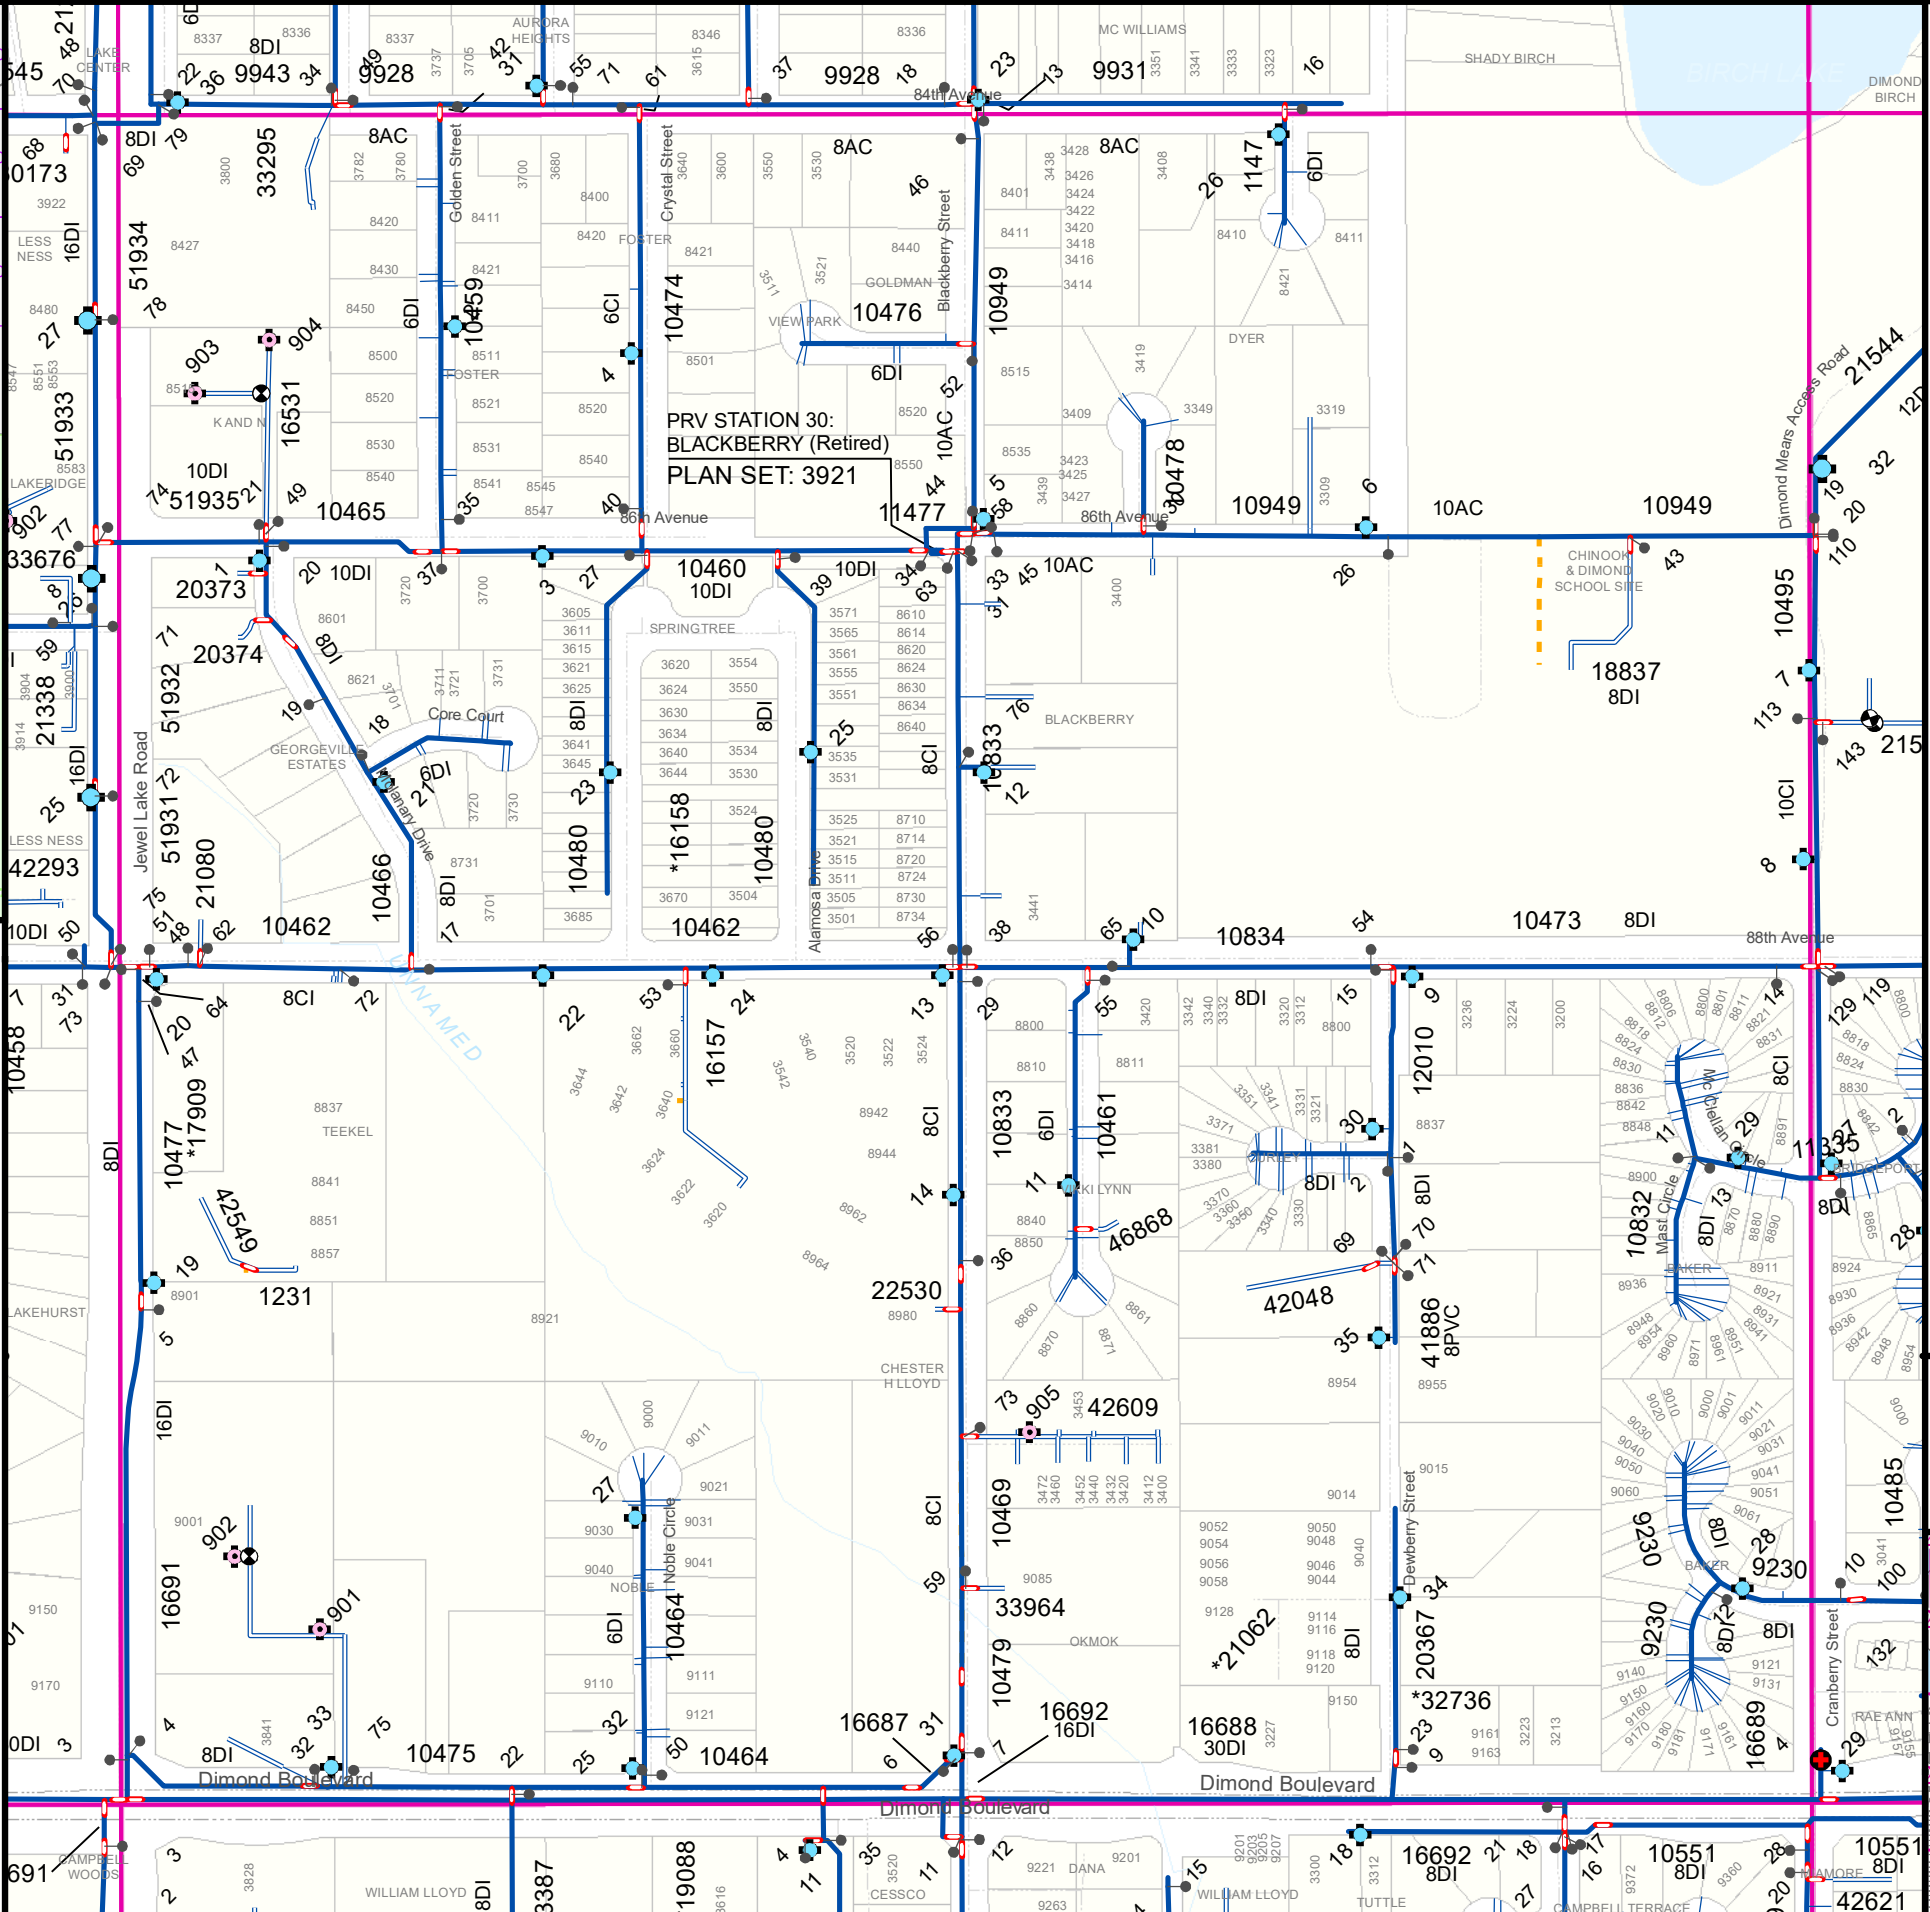

Municipality of Anchorage

Pipe Types

ABS	Acrylonitrile-Butadiene-Styrene
AC	Asbestos Concrete
CC	Concrete Cylinder
CI	Cast Iron
CIPP	Cured In Place Pipe
CMP	Corrugated Metal
CN	Concrete
CU	Copper
DI	Ductile Iron
FC	Formed Concrete
GI	Galvanized Iron
HDPE	High Density Polyethylene
MLC	Mortar Lined Concrete
PE	Polyethylene
PVC	Polyvinylchloride
RC	Reinforced Concrete
ST	Steel
TC	Techite
UNK	Unknown
VC	Vitrified Clay
WS	Wood Stave
WST	Welded Steel
NP	No Print
*	Private System

0 150 300 600 Feet

Map Created: 06/07/2022

Legal:
SW 1/4 Sec11 T12N R4W

SW2326 Grid Number

Water Distribution System

SW2326 Grid Number