



PROPOSED FLOOR PLAN



SCALE: 1/4" = 1'-0"



NOTE:
 PROVIDE MINIMUM 10LB ABC FIRE EXTINGUISHERS AS FOLLOWS: ONE NEAR EACH EXIT AND THEN AS NECESSARY TO PROVIDE A MAXIMUM OF 75 FEET OF TRAVEL DISTANCE BETWEEN EXTINGUISHERS.
 SEE PAGE A-3 FOR WALL SECTION DETAILS

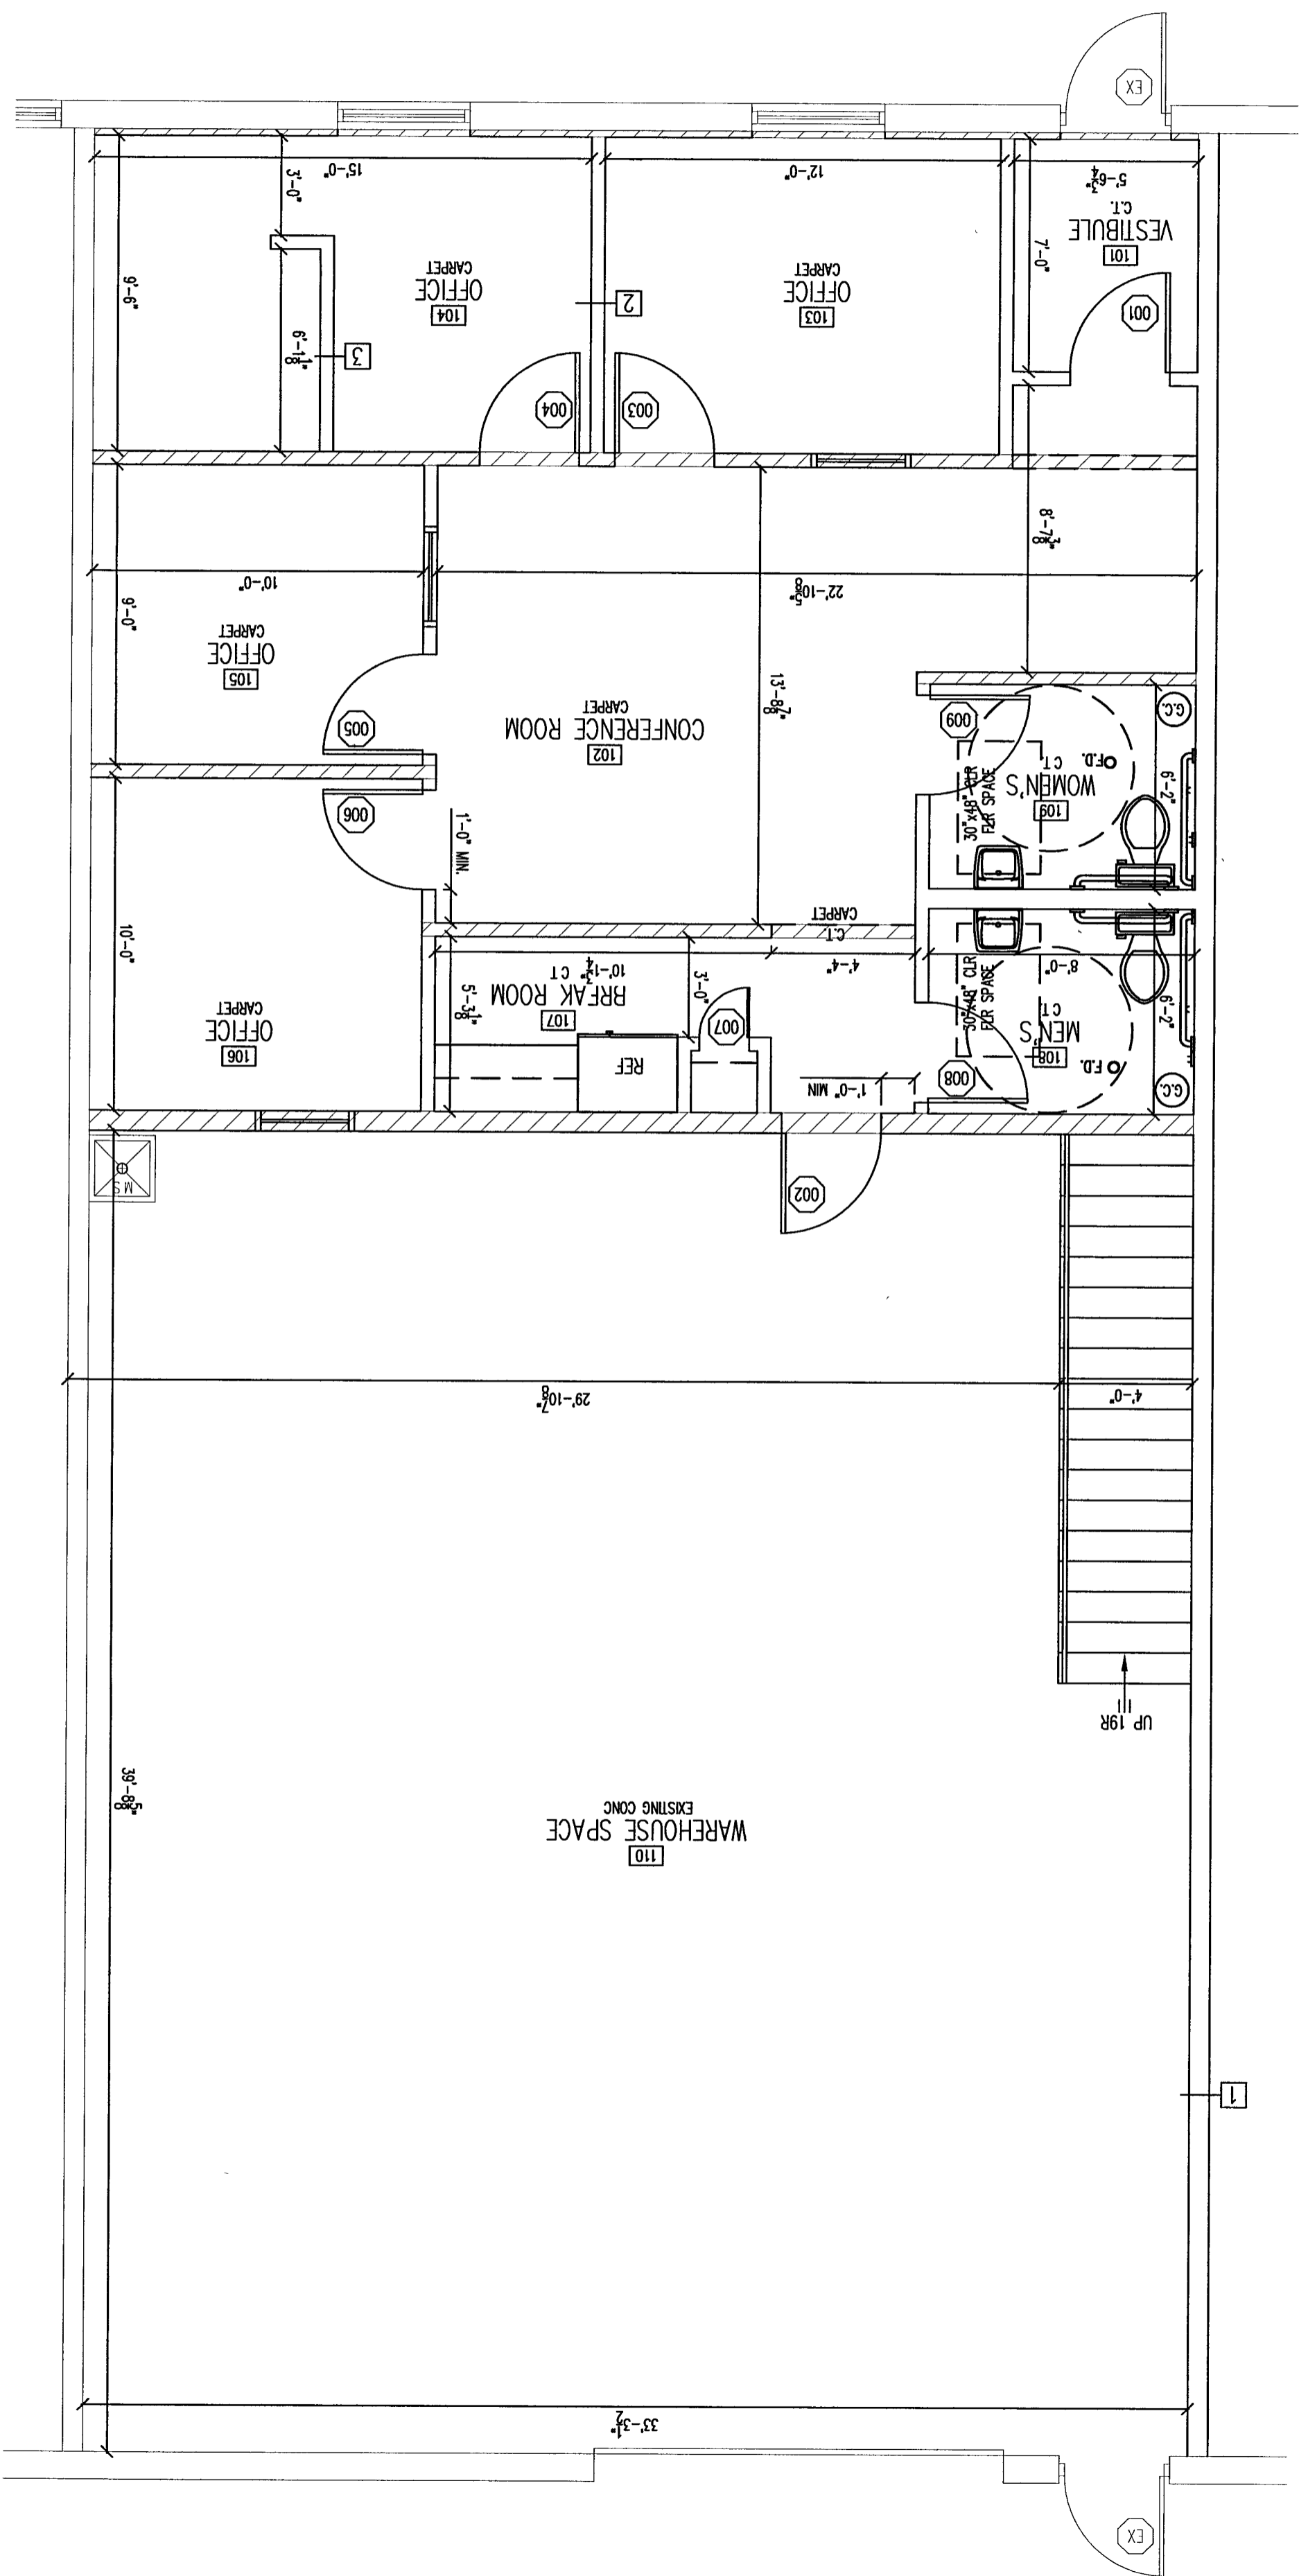

BEARING WALLS LINE JOISTS DIRECTLY ABOVE STUDS