POWER & SYSTEMS NOTES:

1. FIELD VERIFY EXISTING CONDITIONS.
2. EXISTING WALL MOUNTED RECEPTACLE SHALL REMAIN IN OPERATION.
3. EXISTING WALL MOUNTED DATA PORT SHALL REMAIN IN OPERATION.
4. REMOVE EXISTING WALL MOUNTED RECEPTACLE.
5. REMOVE EXISTING WALL MOUNTED DATA PORT.
6. NEW WALL MOUNTED DUPLEX RECEPTACLE. EXTEND CIRCUIT FROM NEAREST TERMINATED RECEPTACLE OR PROVIDE NEW CIRCUIT AS SHOWN. MOUNTED AT 18" AFF OR 42" AFF FOR COUNTERTOP INSTALL.
7. NEW WALL MOUNTED DATA PORT. PULL NEW CAT-6 TO THIS LOCATION FROM OWNERS SELECTED LOCATION.
8. NEW 100-AMP PANEL BOARD 'X' FOR X-RAY EQUIPMENT. PROVIDE NEW FEEDERS FROM ELECTRICAL ROOM VIA ADJACENT TENANT SPACE.
9. NEW DUPLEX RECEPTACLE CONNECTED TO NEW CIRCUIT IN PANEL BOARD X.
10. PROVIDE CONNECTION TO X-RAY EQUIPMENT. FIELD VERIFY MANUFACTURERS RECOMMENDATIONS AND REQUIREMENTS.

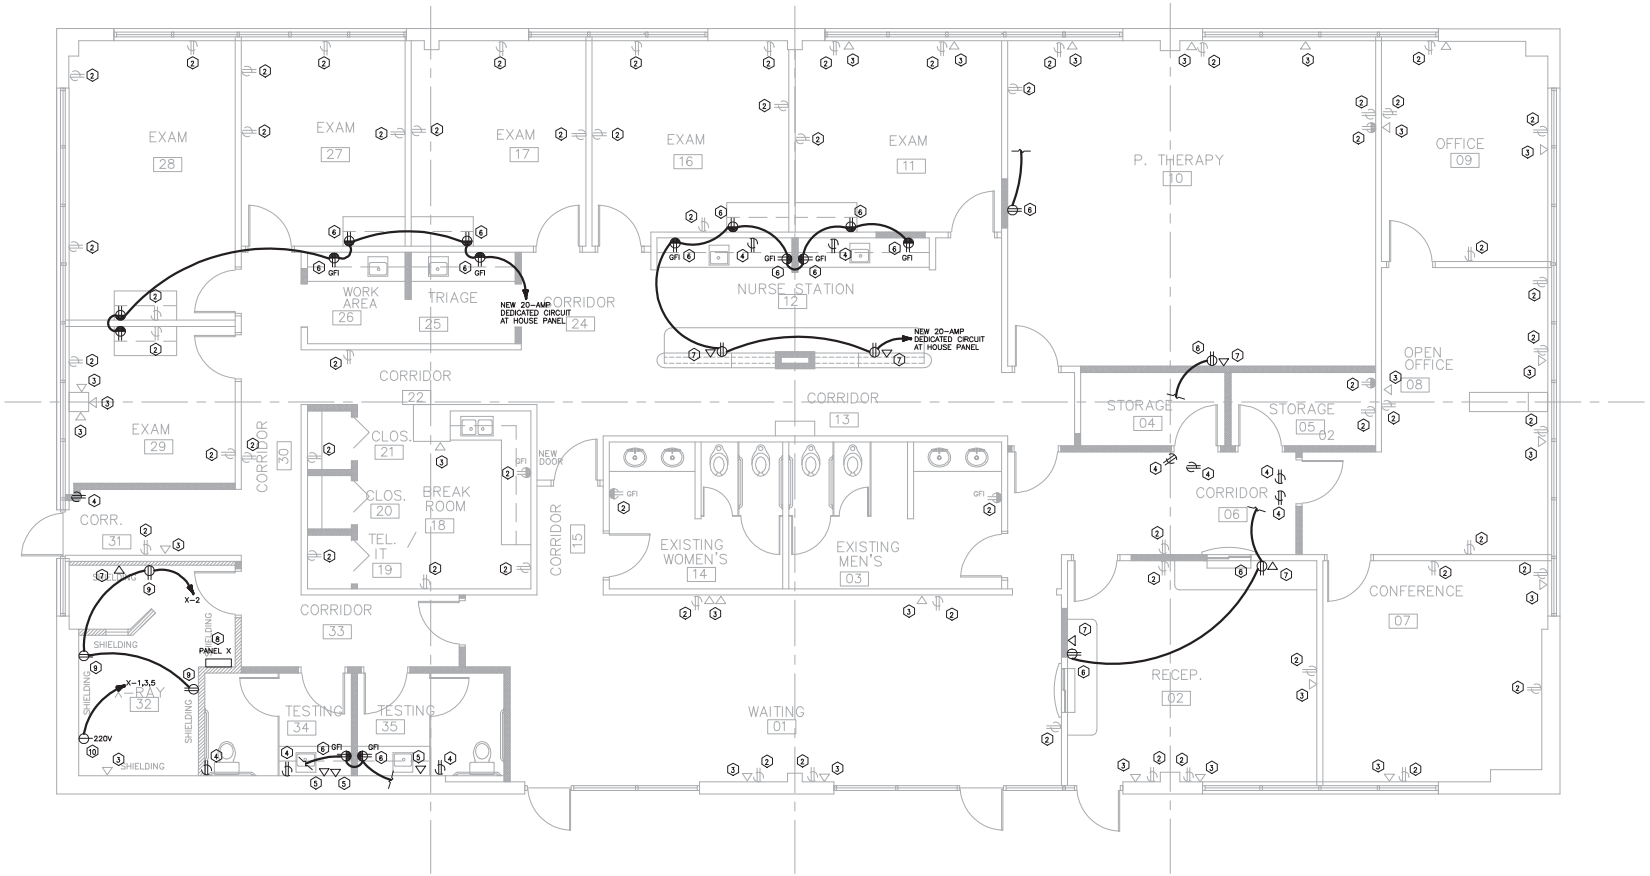

1 / E2 FLOOR PLAN – POWER & SYTEMS

SCALE: 1/4" = 1'- 0"

ISSUED FOR CONSTRUCTION

CADUCEUS

NORCROSS, GA

SUITE 122
5855 JIMMY CARTER BLVD.
NORCROSS, GEORGIA 30071

9/6/2018

ALAN T. CROWLEY, AIA, INC.

5675 TRIANGLE PARKWAY
SUITE 200
NORCROSS, GEORGIA 30092
(770) 840-8504

COMM.NO.:

DRAWN BY:

FLOOR PLAN
POWER & SYSTEMS

☐ REVIEW ONLY
☐ PRICING ONLY
☒ CONSTRUCTION

E2

SEPT. 6, 2018