




Southern Natural Gas Company serving the Augusta GA site.



12" Fire Suppression System with Diesel backup - installed in 2022 for \$5 million

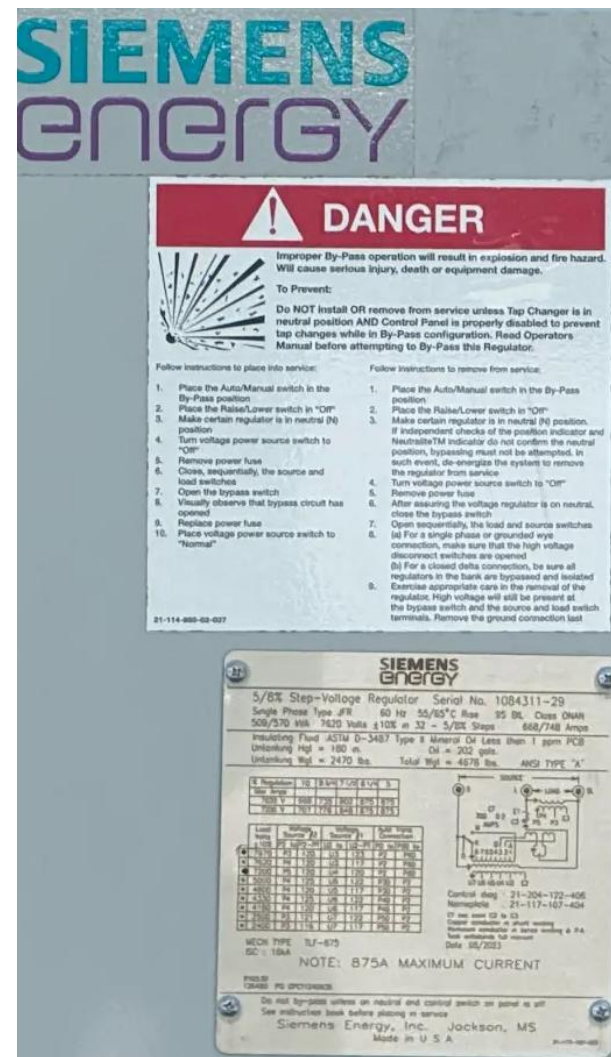

GA Power "East Augusta" yard at 1581 Columbia Nitrogen Drive behind Praxair



GA Power "DSM Evergreen" yard at 1480 Columbia Nitrogen Drive



GA Power "DSM Chemicals" yard at 1754 Columbia Nitrogen Drive



GA Power “unknown named” yard that is now not in service







Site photos showing vacant land where Owner recently demolished former buildings

WARNING

Arc Flash and Shock Risk
Appropriate PPE Required

| | | |
|---|--------------------------------|---|
| 7 in | Arc Flash Boundary | Working Distance: 1 ft 6 in |
| 0.24 cal/cm ² | Minimum Arc Rating of Clothing | |
| See 2021 NFPA 70E Table 130.5(G) for PPE requirements | | |
| 240 VAC | Nominal System Voltage | |
| 00 | Glove Class | |
| 1.75 kA | 3-Phase Bolted Fault Current | |
| Aug 04, 2022 | Label Date | Century 3 Engineering LLC Augusta, Georgia 706-303-4408 |
| Protective Device: | CB-LP6-17/19 | |
| Location: | DISC-X-1761 | |

WARNING

Arc Flash and Shock Risk
Appropriate PPE Required

| | | |
|-------------------------|---|---------------------------|
| 3 ft 10 in | Arc Flash Boundary | |
| 3.1 cal/cm ² | Minimum Arc Rating of Clothing (PPE Cat. 1) | |
| 480 VAC | Nominal System Voltage | |
| 46.07 kA | Available 3-Phase Bolted Fault Current | |
| Jun 05, 2019 | Label Print Date | Century 3 Engineering LLC |
| OCPD | CB-SWGR-S11B-MAIN | Augusta, Georgia |
| Location | SWGR-S11B | 706-303-4408 |



“Allen-Bradley” electric control panel



Building recently vacated by tenant and may soon be demolished by Owner