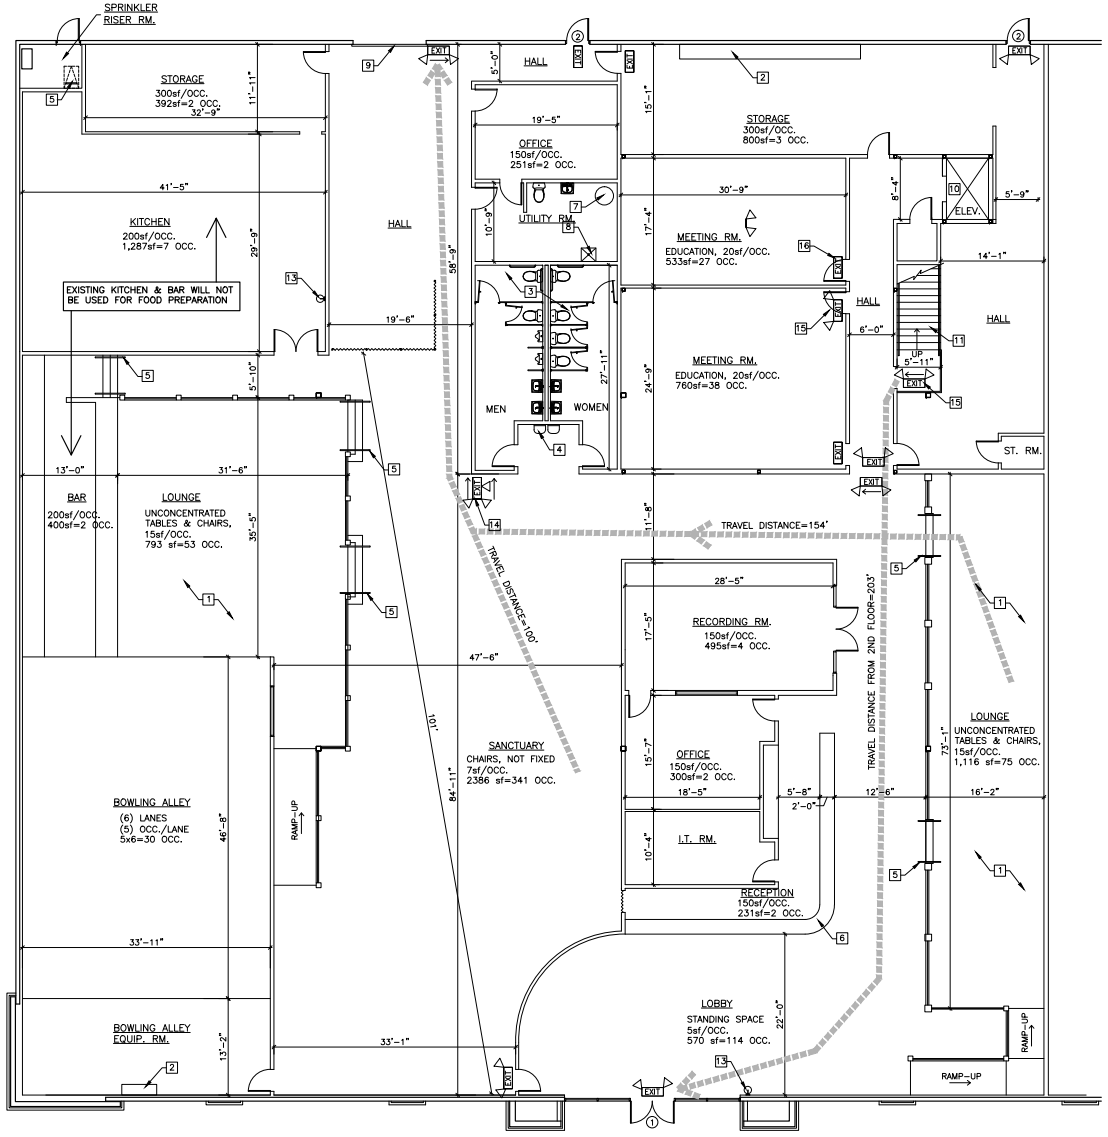

FLOOR PLAN
SCALE: 1/4" = 1'-0"

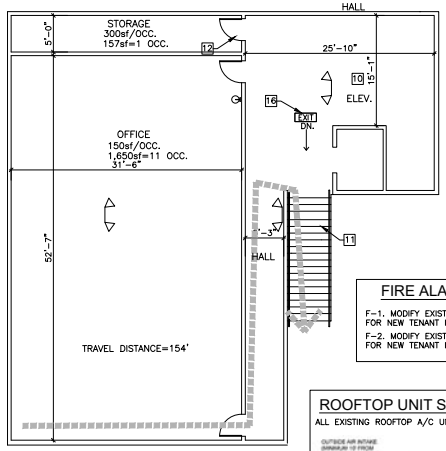

2ND FLOOR PLAN
SCALE: 1/8" = 1'-0"

LEGEND

- 1 KEY NOTE
- EXISTING METAL STUD WALL
- NEW CURTAIN PARTITION

FIRE SYMBOLS

- EMERGENCY EXIT SIGN W/ BATTERY BACKUP & EMERGENCY LIGHTS
- EMERGENCY EXIT SIGN W/ BATTERY BACKUP
- EMERGENCY EXIT LIGHT W/ BATTERY BACKUP
- FIRE EXTINGUISHER

EGRESS DOOR / HARDWARE

① EXISTING: (2) 3'-0" x 7'-0" x 1-3/4" ALUM. & GLASS DOOR IN ALUM. FRAME. KEYED STYLE DEAD BOLT LOCK, PUSH & PULLS, STOP, CLOSER. W/ SIGN "THIS DOOR TO REMAIN UNLOCKED WHILE BUILDING IS OCCUPIED. ADA COMPLIANT.

② EXISTING 3'-0" x 7'-0" X 1-3/4" HOLLOW DOOR IN STEEL FRAME. SECURITY LOCK, CLOSER, PANIC DEVICE. ADA COMPLIANT.

PATH OF EGRESS, EMERGENCY LIGHTING REQUIREMENTS

THE EXISTING EMERGENCY LIGHTING SYSTEM SHALL BE TESTED AND MODIFIED IF NECESSARY AS REQUIRED TO MEET THE FOLLOWING MINIMUM LIGHTING REQUIREMENTS IN THE 2018 IBC

1008.3.4 Duration. The emergency power system shall provide power for a duration of not less than 90 minutes and shall consist of storage batteries, unit equipment or an on-site generator. The installation of the emergency power system shall be in accordance with Section 2702.

1008.3.5 Illumination level under emergency power. Emergency lighting facilities shall be arranged to provide initial illumination that is not less than an average of 1 footcandle (11 lux) and a minimum at any point of 0.1 footcandle (1 lux) measured along the path of egress at floor level. Illumination levels shall be permitted to decline to 0.6 footcandle (6 lux) average and a minimum at any point of 0.06 footcandle (0.6 lux) at the end of the emergency lighting time duration. A maximum-to-minimum illumination uniformity ratio of 40 to 1 shall not be exceeded. In Group I-2 occupancies, failure of a single lamp in a luminaire shall not reduce the illumination level to less than 0.2 footcandle (2.2 lux).

FIRE ALARM & SPRINKLER NOTES

F-1. MODIFY EXISTING FIRE SPRINKLER SYSYEM AS REQUIRED FOR NEW TENANT IMPROVEMENTS.

F-2. MODIFY EXISTING FIRE ALARM SYSYEM AS REQUIRED FOR NEW TENANT IMPROVEMENTS.

ROOFTOP UNIT SMOKE DETECTOR DETAIL

ALL EXISTING ROOFTOP A/C UNITS ARE EQUIPED WITH SMOKE DETECTORS.

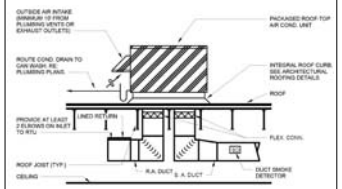

GENERAL NOTES

A. ALL TENANT IMPROVEMENTS SHOWN ON THE FLOOR PLAN ARE EXISTING UNLESS NOTED OTHERWISE.

1 KEY NOTES

ALL ITEMS LISTED BELOW ARE EXISTING UNLESS NOTED OTHERWISE.

1. RAISED PLATFORM.
2. ELECTRIC PANELS.
3. RESTROOM.
4. DRINKING FOUNTAINS.
5. NEW HANDRAILS TO BE INSTALLED ON BOTH SIDES OF EXISTING STAIRS. SEE DETAIL 1/A1.1
6. RECEPTION COUNTER.
7. WATER HEATER.
8. SERVICE SINK.
9. OVERHEAD DOOR.
10. ELEVATOR.
11. STAIRS.
12. NEW FIRE EXTINGUISHER.
13. EXISTING FIRE EXTINGUISHER.
14. ADD (1) LIGHT AND ARROW TO EXISTING EXIT SIGN.
15. INSTALL NEW EXIT SIGN W/ EMERGENCY LIGHTS.
16. INSTALL NEW EXIT SIGN.
17. 1-1/2" DIA. STEEL PIPE RAILING AND SUPPORT POST



STAIR RAILING DETAIL - 1
SCALE: 1/2" = 1'-0"

12/22/21

EMMETT SACREY ARCHITECT
1342 CR 213
WEIMAR, TEXAS 78962
(281) 705-6353
emmett@elsarchitect.com

THE PLACE

A PLACE OF RELIGIOUS WORSHIP

PROJECT ADDRESS
24984
KATY RANCH RD.
KATY, TEXAS 77494

DRAWING DATE:	12/22/21
REVISIONS:	
ISSUED FOR:	DATE
REVIEW:	
PERMITS:	12/22/21
BID:	
CONSTRUCTION:	
SCALE:	NOTED
DRAWN BY:	ELS
JOB NO:	21-17

SHEET NAME
FLOOR PLAN

SHEET NO.:
A1.1