



Space Profile for

Unit: #B0R


Area: 3312 sq ft

Address







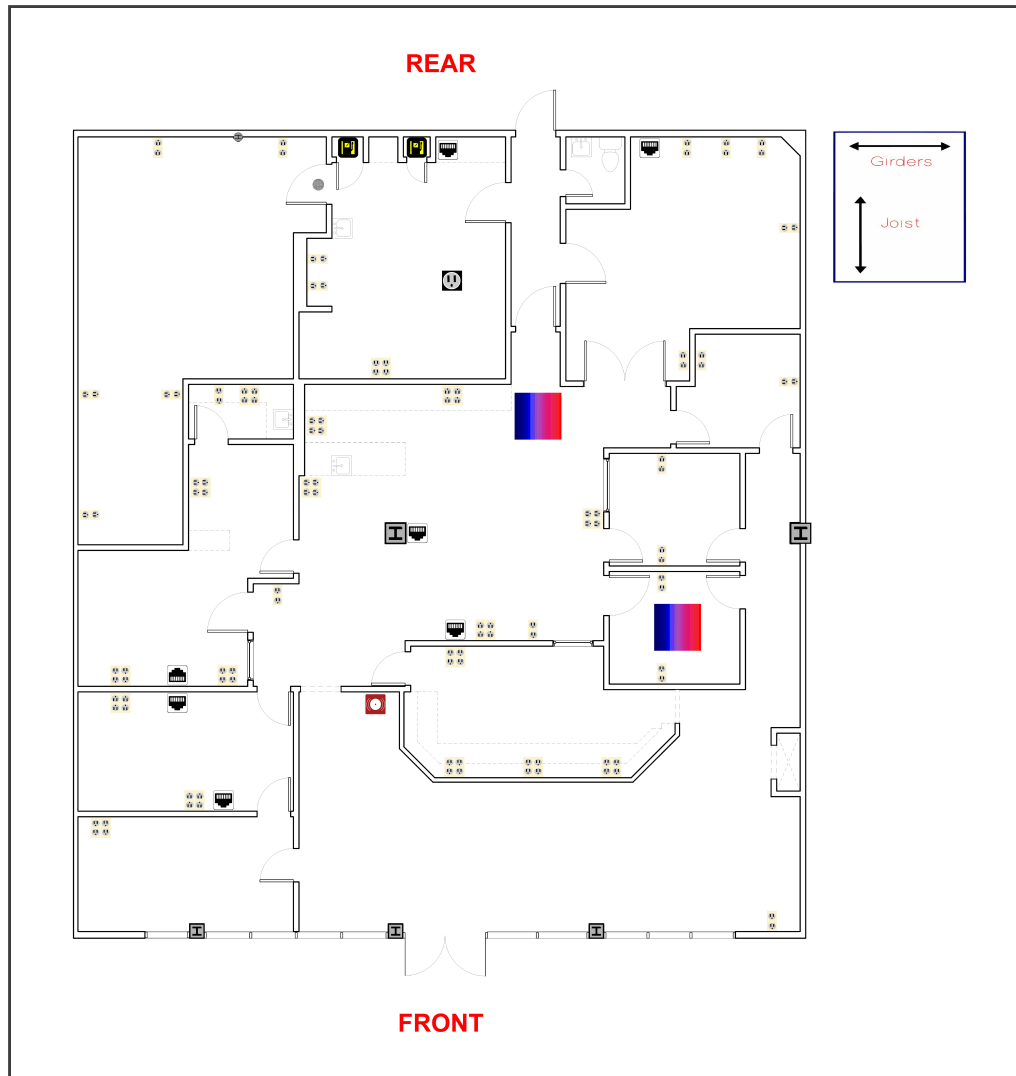









































*5215 FM 1960 Rd. W. Ste. X
Houston, TX 77069*



*400 N. Tampa St., Suite 2210
Tampa, FL, 33602*



Legend

	Breaker Panel		Fire Extinguisher		Ceiling Fan w/ Light		Fire Sprinkler
	Circular Column		Fire Alarm Pulldown		Rectangular Column		Pocket Door
	Appliance Outlet		Glass Door		Refrigerator		Track Lighting
	Fire Alarm		Handicap Handrail		Roll-Up Door		2-Bulb Fluorescent Lighting
	Drinking Fountain		Roof Hatch		Sink		3-Bulb Fluorescent Lighting
	Door		HVAC Unit		Swing Door		4-Bulb Fluorescent Lighting
	Double Hung Door		Recessed Light		Toilet		Ceiling Air Vent
	Electrical Outlet		Staircase		Can Light		Air Diffuser
	Emergency Light		Water Heater		Urinal		Ceiling Fan w/o Light
	Exit Light		Telephone Panel		Thermostat		Air Handler
	Tankless Water Heater		Window Wall Opening		RJ 45		Fire Alarm Control Panel
	Step Down Transformer		Maintenance Sink		Window		
	Disconnect						

Disclaimer: All items may not show on feature pages.



Space Overview

Overview	Actual Square Footage	Measured Depth of Space	Total Depth of Space	Has Stepdown Transformer
	3312 SQFT	60' 0"	60' 0"	No

Thickness	Front Wall	Rear Wall	Left Wall	Right Wall
	0' 6"	0' 6"	0' 4"	0' 5"

Flooring	Concrete	Carpet	Tile	Other	Unit	Total
	657.6 SQFT		1020.75 SQFT	1343.21 SQFT	3312 SQFT	3021.56 SQFT

Ceiling Information	Height From Floor To Ceiling	Height From Floor To Bottom Of Deck	Height From Floor To Bottom Of Joist
	Front: 10' 11" Back: 7' 10"	Front: 14' 6" Back: 13' 8"	Front: 13' 3" Back: 12' 5"

Ceiling Information Cont.	Clear Ceiling Height	Height From Floor To Bottom Of Girder	Number Of Acoustical Tiles
	7' 8"		

Other Cont.	Phone Board Location	Mop Sink Location	Thermostat Location	Dmarc Distance	Are Interior Walls Full Height
					No

Other Cont.	Hazardous Materials	Loading Dock	Are Demising Walls Full Height	Changes In Demising Wall Thickness
	No	No	No	No

Mechanical

HVAC	Reference	Manufacturer	Model	Serial	Tonnage	Year	Notes
	40	BRYANT	558DEX060000AAHA	4597G21265	5	1997	
	39	BRYANT	LABEL MISSING	LABEL MISSING			

Electric

Disconnect	Reference	Amps	Location	Panel Number	Manufacturer	Notes	Handle or Breaker
	38	0	Rear Exterior Wall Mounted; Behind B0D	Not Listed	Cutler-Hammer		Handle

Service Panel	Reference	Amps	Service Type	Panel Type	Panel UL Number	Manufacturer	Location	Notes
	2	225	277/480	NHB	BD-119014	General Electric	Maintenance Room Closet	
1	225	120/208	NLTQ	BD-384500	General Electric	Maintenance Room Closet		

Electric Meter	Reference	Meter #	Location	Meter Reading	Read On	Voltage	Notes
	38	NO METER	Rear Exterior Wall Mounted				

Plumbing

House Water Meter	Reference	Meter #	Location	Size	Notes
		6	19131379	In Vault At Plaza Entry	

Waste

No assets available for this section.

Fire

Sprinkler Heads	Sprinkler Heads Present	Sprinkler Head Type	Riser Located in Space	Riser Location	Additional Information
		0	No Fire Sprinklers in Unit	No	No Fire Sprinklers in Building

Gas

No assets available for this section.

Room

Restroom	Unit	Description
	Restroom 1	Unisex Restroom 1

Storefront 1

